



**CLEAN DEVELOPMENT MECHANISM
PROJECT DESIGN DOCUMENT FORM (CDM-PDD)
Version 03 - in effect as of: 28 July 2006**

CONTENTS

- A. General description of project activity
- B. Application of a baseline and monitoring methodology.
- C. Duration of the project activity / crediting period
- D. Environmental impacts
- E. Stakeholders' comments

Annexes

- Annex 1: Contact information on participants in the project activity
- Annex 2: Information regarding public funding
- Annex 3: Baseline information
- Annex 4: Monitoring plan

**SECTION A. General description of project activity****A.1 Title of the project activity:**

Beijing Taiyanggong CCGT Trigeneration Project

Version 1

Date of completion: 22 January 2007

A.2. Description of the project activity:

The Beijing Taiyanggong CCGT Trigeneration Project (hereinafter referred to as “the project”) proposes to install and operate a 780MW grid connected natural gas fired combined cycle power plant in the Taiyanggong area of Chaoyang District in Beijing.

The project will supply electricity to the Beijing grid (a fully integrated subsidiary of the North China Power Grid), the net annual power output of the project will be 3,266 GWh. In addition, the project will supply waste steam for heating and cooling to an area of 40 km² so that 78 existing boilers with a low efficiency will be removed. Only emissions reductions from electricity generated are claimed however.

The project comprises of the following activities:

- Installation of two sets of natural gas-fired combined cycle power generation units (including gas turbines, heat recovery steam generators, a steam turbine and power generators). The total capacity will be 780MW;
- Installation of two sets of diesel power generation units to supply electricity to shutdown turbines smoothly and safely;
- Installation of natural gas compressors;
- Installation of a monitoring and control system
- Installation of auxiliary systems to support the gas-steam combined cycle

In this system, natural gas is sent to the gas turbine for power generation. The flue gas is then sent to the heat recovery steam generator to generate steam with a high temperature and pressure. This steam drives the steam turbine to generate more electrical power.

The project will contribute to both local and global sustainable development in a number of ways:

- The project will lead to a reduction in greenhouse gas emissions compared to a business as usual approach;
- The project will reduce other pollutants (including SO₂, NO_x and particulates) resulting from the power generation industry in China, compared to a business as usual approach, thereby improving local environment quality;
- The project will provide flexible generation capacity with rapid start-up and shut-down, meaning that it is suitable to serve as a source to regulate peak-loads, helping to improve the quality of the



- power grid;
- The project will provide local employment for about 200 people.

A.3. Project participants:

Name of Party involved (*) (host) indicates a host Party)	Private and/or public entity(ies) project participants (*) (as applicable)	Party involved wishes to be considered as project participant (Yes/No)
People's Republic of China (Host)	Beijing Taiyanggong Gas-fired Thermal Power Co. (Project Owner)	No
United Kingdom of Great Britain and Northern Ireland	Camco International Limited (Purchasing Party)	No
United Kingdom of Great Britain and Northern Ireland	Macquarie Bank Limited (Purchasing Party)	No

A.4. Technical description of the project activity:**A.4.1. Location of the project activity:****A.4.1.1. Host Party(ies):**

People's Republic of China

A.4.1.2. Region/State/Province etc.:

Beijing

A.4.1.3. City/Town/Community etc:

Chaoyang District

A.4.1.4. Detail of physical location, including information allowing the unique identification of this project activity (maximum one page):

The project is located in the north-east of Beijing in Chaoyang District, between the North Third Ring-road and the North Fourth Ring-road. The site is 0.5km from the Fourth Ring-road in the north and 0.5km from Laiguangying Road. The site is about 450m long from north to south and between 120 and 260m wide, from east to west. The total land area for the project is 76,000 m². The geographical coordinates are:

39.967°N, 116.417°E

Figures 1 and 2 show the location of the project.

Figure 1: Map of the location of the proposed project in China

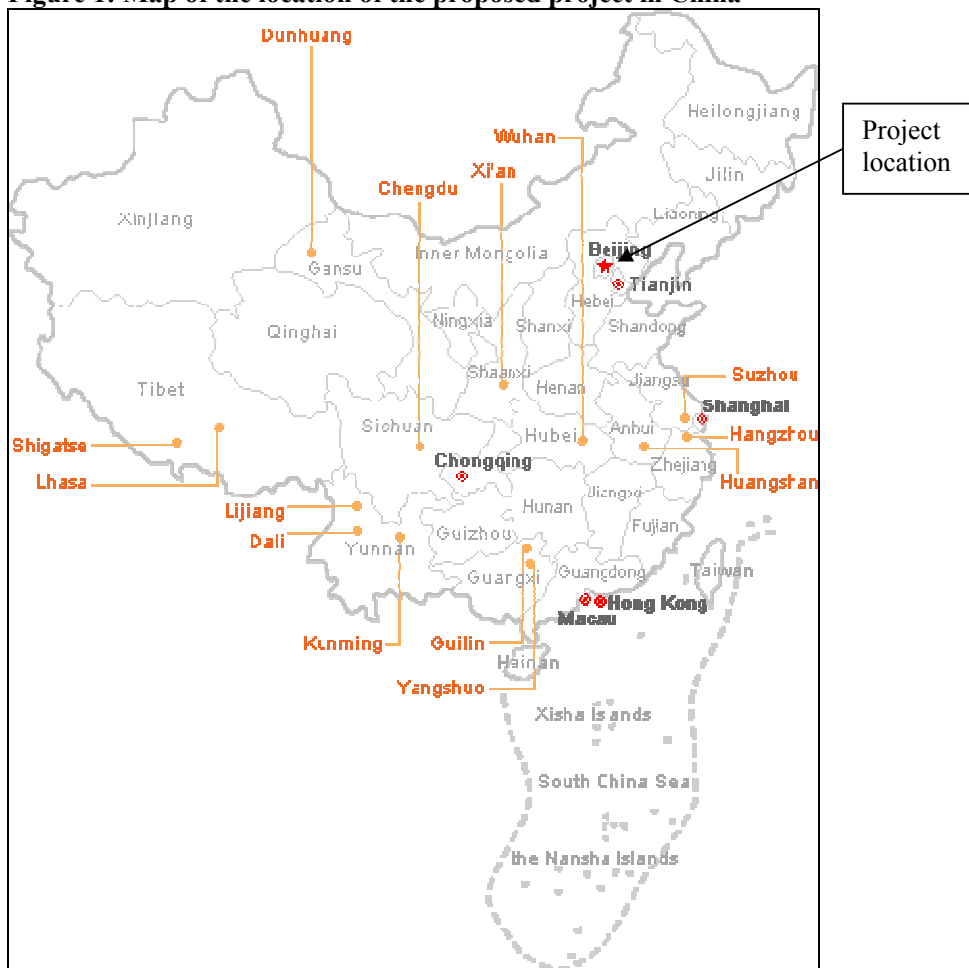


Figure 2: Map of the location of the proposed project in Beijing**A.4.2. Category(ies) of project activity:**

Sectoral Scope 1: Energy Industries (non-renewable resources)

A.4.3. Technology to be employed by the project activity:

The project will comprise the following activities:

- Installation of a 780MW natural gas-fired combined cycle power generation system. This will consist of:
 - 2 PG9351 gas turbines, each with an efficiency of 36.8% (manufactured by GE and imported to China)¹
 - 2 heat recovery steam generators (produced by CMI HRSG, a division of the Belgian Group Cockerill Maintenance Ingenierie, but manufactured in China)
 - 1 LN273/CC1545-11.47/0.613/0.294/566/566 steam turbine with an efficiency of 45% (manufactured in Harbin, China)²
- Installation of two sets of diesel power generation units (2 x 800kW) to supply electricity to shutdown turbines smoothly and safely;

¹ Efficiency as quoted in equipment supply contract from manufacturer


² ibid



- Installation of natural gas compressors;
- Installation of a monitoring and control system;
- Installation of auxiliary systems to support the gas-steam combined cycle.

In this system, natural gas is sent to the gas turbine for power generation. The flue gas is then sent to the heat recovery steam generator to generate steam with a high temperature and pressure. This steam drives the steam turbine to generate more electrical power.

Figure 3: Process diagram

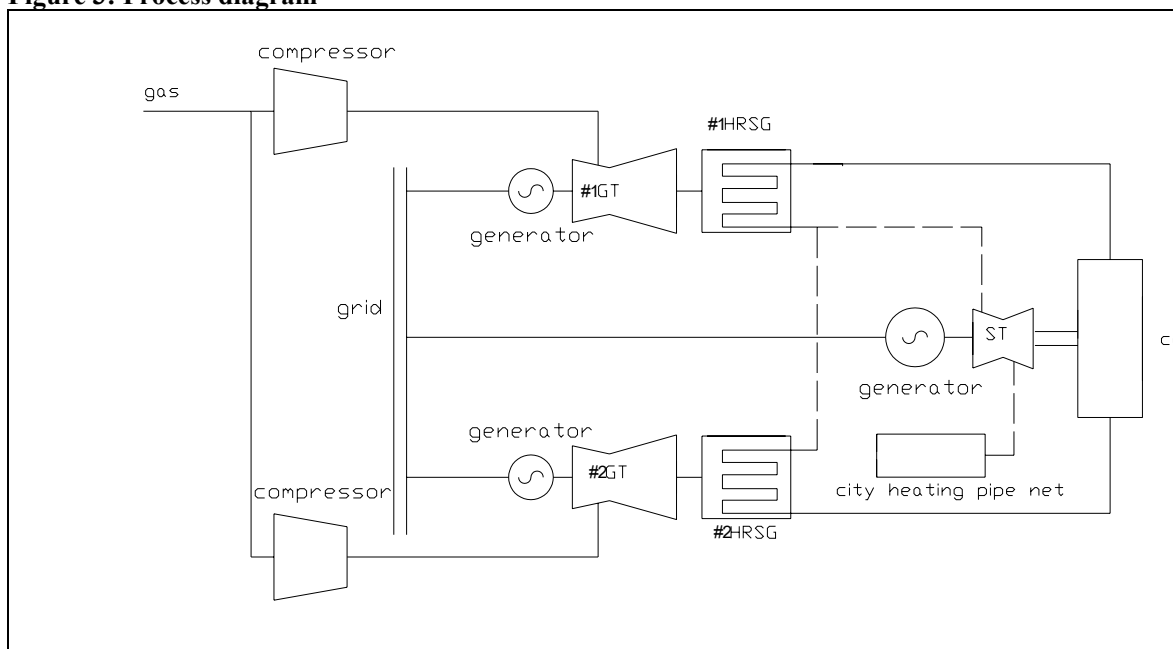

**A.4.4 Estimated amount of emission reductions over the chosen crediting period:**

The selected crediting period for the project is renewable – 3 x 7 years. The estimated emissions reductions for the first crediting period are given below:

Table 1: Estimated emissions reductions during the crediting period

Years	Annual estimation of emission reductions in Tonnes of CO₂ e
2007 (1.5 months)	188,856
2008	1,510,848
2009	1,510,848
2010	1,510,848
2011	1,510,848
2012	1,510,848
2013	1,510,848
2014 (10.5 months)	1,321,992
Total estimated reductions (tonnes of CO₂e)	10,575,938
Total number of crediting years	7
Annual average over the crediting period of estimated reductions (tonnes of CO₂e)	1,510,848

A.4.5. Public funding of the project activity:

There are no public funds involved in the project activity.

**SECTION B. Application of a baseline and monitoring methodology****B.1. Title and reference of the approved baseline and monitoring methodology applied to the project activity:**

The baseline and monitoring methodology used is AM0029: “Grid Connected Electricity Generation Plants using Natural Gas” (AM0029/ version 01, sectoral scope 01, 19 May 2006)³.

ACM0002: “Consolidated methodology for grid-connected electricity generation from renewable sources” (ACM0002/ version 06, sectoral scope 1, 19 May 2006)⁴ is used to calculate the build margin and combined margin.

The additionality of the project activity is demonstrated and assessed using the “Tool for the demonstration and assessment of additionality” (Version 2)⁵.

For more information, see <http://cdm.unfccc.int/meth/approved>.

B.2 Justification of the choice of the methodology and why it is applicable to the project activity:

The AM0029 baseline methodology and accompanying monitoring methodology are applicable to the Taiyanggong Natural Gas-Fired Combined Cycle Power Plant project because the proposed project meets all the applicability criteria stated in the methodology:

1. The proposed project will involve electricity capacity additions of 780MW from new gas-fired generation plant
2. The geographic and system boundary of the North China Power Grid can be clearly identified and information on the characteristics of the grid is available (refer to section B3)
3. There is sufficient gas supply in the region for the project. Natural gas for the project will be supplied via the Shaanjing Number 2 line which will bring gas from the Changqing gas field in western China to Beijing. Total natural gas reserves in this gas field amount to 4180 billion m³⁶. The present proved rate of the resource is only 8.2% meaning that the back-up resource is sufficient and the exploration potential is large.

The combined total gas supply volume to Beijing from ShaanJing number 1 and number 2 lines is estimated to be 9.1 billion m³ of natural gas each year, of which this project will use an approximately 730 million m³. Demand for natural gas in Beijing is growing and is predicted to reach 5.8 billion m³

³ <http://cdm.unfccc.int/methodologies/PAmethodologies/approved.html>

⁴ ibid

⁵ http://cdm.unfccc.int/methodologies/PAmethodologies/AdditionalityTools/Additionality_tool.pdf

⁶ Beijing Guodian Huabei Power Engineering Co. Ltd., Beijing Taiyanggong Gas-fired Trigeneration Power Project Feasibility Study Report, June 2005



in 2008, and 8.5 billion m³ 2014⁷. These figures indicate that sufficient natural gas will be available in Beijing for the project.

B.3. Description of the sources and gases included in the project boundary

According to AM0029/ Version 1, in the calculation of project emissions, only CO₂ emissions from fossil fuel combustion at the project plant are considered. In the calculation of baseline emissions, only CO₂ emissions from fossil fuel combustion in power plants in the baseline are considered.

The greenhouse gases included in or excluded from the project boundary are listed as follows:

Table 2: Overview of emissions sources included in or excluded from the project boundary

	Source	Gas	Included?	Justification / Explanation
Baseline	Fossil fuel use	CO ₂	Yes	Main emission source
		CH ₄	No	Excluded for simplification. This is conservative.
		N ₂ O	No	Excluded for simplification. This is conservative.
Project Activity	On-site fuel combustion due to the project activity	CO ₂	Yes	Main emission source
		CH ₄	No	Excluded for simplification.
		N ₂ O	No	Excluded for simplification.

The Taiyanggong Natural Gas-Fired Combined Cycle Power Plant Project is situated in Beijing which is part of the North China Power Grid (NCPG). According to newly published information by the China DNA relating to the division of the regional power grids, this grid, historically, covered the provinces of Beijing, Tianjin, Hebei, Shanxi and Inner Mongolia. At the end of 2004, an interconnection was made between the NCPG and the previously independent Shandong power grid. For the purposes of this analysis therefore, the project boundary selected is Beijing, Tianjin, Hebei, Shanxi, Inner Mongolia and Shandong. Data is easily available from the China DNA, the annually published China Electric Power Yearbook and the annually published China Energy Statistical Yearbook.

Net exports from the province were about 2% in 2004 (see table 3 below).

Table 3: Transfers to and from the NCPG

	2000	2001	2002	2003	2004
Total imports (100 GWh)	256.65	281.49	288.82	315.56	382.86
Total exports (100 GWh)	379.87	431.04	487.25	518.36	559.74
Total net transfers (100 GWh)	-123.22	-149.55	-198.43	-202.8	-176.88
Total generation (100 GWh)	5581.4778	6086.24	6871.52	7795.82	8933.43
%imports/ exports	-2%	-2%	-3%	-3%	-2%

B.4. Description of how the baseline scenario is identified and description of the identified baseline scenario:

According to Version 01 of AM0029, the following steps are used to define the baseline scenario

⁷ http://english.people.com.cn/200404/13/eng20040413_140287.shtml

**Step 1: Identify plausible baseline scenarios**

Alternatives to be analysed should include:

- A. The project activity not implemented as a CDM project;
- B. Power generation using natural gas, but technologies other than the project activity;
- C. Power generation technologies using energy sources other than natural gas;
- D. Import of electricity from connected grids, including the possibility of new interconnections.

The alternatives should: 1) deliver similar services (e.g. peak vs. baseload power); 2) include all relevant power plant technologies that have recently been constructed or are under construction or are being planned; and 3) exclude baseline scenarios that are not in compliance with all applicable legal and regulatory requirements.

The project activity will increase the installed capacity of the North China Power Grid (NCPG). The project activity is characterized by rapid startup/shutdown speed and flexible operation, suitable to serve as a regulating power source and therefore improves the operation quality of the power grid.

Potential baseline scenarios are listed in table 4 below.

Table 4: Baseline scenarios

Alternatives	Plausibility / Eligibility
A. The project activity not implemented as a CDM project	
Natural Gas CCGT	Plausible and meets eligibility criteria.
B. Power generation using natural gas, but technologies other than the project activity	
Natural Gas Open-Cycle	Not plausible. Open cycle plants are not economical for capacities as high as 700MW, due to their relatively low levels of efficiency.
C. Power generation technologies using energy sources other than natural gas	
Coal Super-critical	Plausible and meets eligibility criteria.
Coal Sub-critical	Plausible and meets eligibility criteria.
Oil	Not plausible. The use of fuel oil in the NCPG declined by 55% between 1990 and 2004, and so cannot be seen as part of current or future power plant technologies.
Nuclear	Not plausible. There is currently no nuclear power in the NCPG. Further, nuclear power would not deliver similar services to the project.
Hydro	Not plausible. There are minimal hydro resources in north China and due to the long timelines for the development of projects; hydro power would be unable to provide regulation to the NCPG in the short to medium term.
Wind	Not plausible. Wind power plants have low plant load factors and so could not meet the 700MW capacity



	requirement. The intermittent nature of electricity generated by wind power means that wind could not act as a regulating power source.
D. Import of electricity from connected grids, including the possibility of new interconnections	
Import from neighbouring power grids	Not plausible. As can be seen above in Table 3 the NCPG has been a net exporter for the past 5 years, and so it is unlikely that neighbouring grids will be able to provide it with additional capacity.

To summarise, the following scenarios are deemed to be plausible and meet the baseline criteria:

- A – New sub-critical coal plant (2 x 300MW)
- B – New sub-critical coal plant (2 x 600MW)
- C – New super-critical coal plant (2 x 600MW)
- D – Project activity (Natural Gas CCGT) not under taken as a CDM project

Step 2: Identify the economically most attractive baseline scenario alternative.

According to Version 01 of AM0029, the economically most attractive baseline scenario alternative is identified using levelised cost as a financial indicator. The levelised cost is therefore calculated for scenarios A and B above.

The basic levelised cost methodology used in this PDD is based on Annex 5 of ‘Projected Costs of Generation Electricity: 2005 update’ published by IEA⁸. The formula applied to calculate the levelised electricity generation cost (EGC) is the following:

$$EGC = \frac{\sum_t [(I_t + M_t + F_t) (1 + r)^{-t}]}{\sum_t [E_t (1 + r)^{-t}]}$$

- With:
- EGC: Average lifetime levelised electricity generation cost per kWh
 - I_t: Capital expenditure in the year t
 - M_t: Operation and maintenance expenditures in the year t
 - F_t: Fuel expenditure in the year t
 - E_t: Electricity generation in the year t
 - r: Discount rate

⁸ IEA, Projected Costs of Generating Electricity, 2005 update

**Table 5: Assumptions and Parameters for Levelised Cost Calculations**

	A. Sub-critical coal plant (2x300MW) ¹	B. Sub-critical coal plant (2x600MW) ¹	C. Super-critical coal plant (2x600MW) ¹	D. CCGT (780MW) ²	Unit
Construction period	3	3	4	2	years
Lifetime	25	25	25	20	years
Operating hours	5,000	5,000	5,000	4,326	hours pa
Capital Cost	2,757,600,000	4,498,120,000	4,702,800,000	2,182,426,678	RMB
Coal Expenditure ³	210	210	210	n/a	RMB/ tonne
Gas Expenditure	n/a	n/a	n/a	1.55	RMB/ m ³
Coal used ⁴	945,000	1,890,000	1,794,000	n/a	tonne
Gas used	n/a	n/a	n/a	484,795,046	m ³
Fuel Expenditure	198,450,000	396,900,000	376,740,000	751,432,321	RMB
Electricity Generation	2,781,000	5,562,000	5,616,000	3,266,032	MWh
Discount Rate	0.08	0.08	0.08	0.08	
Material expenditure	n/a	n/a	n/a	11,242,752	RMB
Other O&M expenditure	42,260,000	71,360,000	71,360,000	20,236,953	RMB
Water expenditure	21,000,000	36,000,000	36,000,000	4,901,840	RMB
Desulferisation expenditure	3,439,800	6,879,600	6,530,160	n/a	RMB
Overhaul of equipment	68,940,000	112,453,000	117,570,000	65,472,800	RMB
Employee expenditure	18,720,000	19,760,000	19,760,000	10,263,093	RMB
Total O&M expenditure	154,359,800	246,452,600	251,220,160	112,117,437	RMB

¹ China Institute of Power Planning and Design, Thermal Power Engineering Design Reference Cost Index, 2005 edition

² Taiyanggong Natural Gas-Fired Combined Cycle Power Plant Project Feasibility Study Report. According to the FSR, the ratio of electricity generated: heat generated is 2:1. To ensure conservativeness, costs above are for the electricity element only.

³ Typical coal price for the NEPN area. Based on coal price used in financial analysis in Shanxi Zhongshan FSR

Based on the above parameters and the levelised cost calculation formula, the levelised cost of each plausible generation technology can be calculated, and a sensitivity analysis performed.

Table 6: Results and Sensitivity Analysis for Levelised Cost Calculations

	Levelised Cost	Load Factor				
		(+)20%	(+)10%	0	(-)10%	(-)20%
A. 2x300 MW sub-critical coal plant	0.228	0.190	0.207	0.228	0.253	0.285
B. 2x600 MW sub-critical coal plant	0.198	0.165	0.180	0.198	0.220	0.248
C. 2x600 MW super-critical coal plant	0.201	0.170	0.186	0.201	0.227	0.255
D. 780 MW CCGT	0.335	0.279	0.305	0.335	0.372	0.419

	Levelised Cost	Fuel Cost				
		(+)20%	(+)10%	0	(-)10%	(-)20%
A. 2x300 MW coal plant	0.228	0.242	0.235	0.228	0.221	0.214
B. 2x600 MW sub-critical coal plant	0.198	0.212	0.205	0.198	0.191	0.184
C. 2x600 MW super-critical coal plant	0.201	0.215	0.208	0.201	0.195	0.188
D. 780 MW CCGT	0.335	0.381	0.358	0.335	0.312	0.289

Figure 4: Variation of levelised cost with load factor


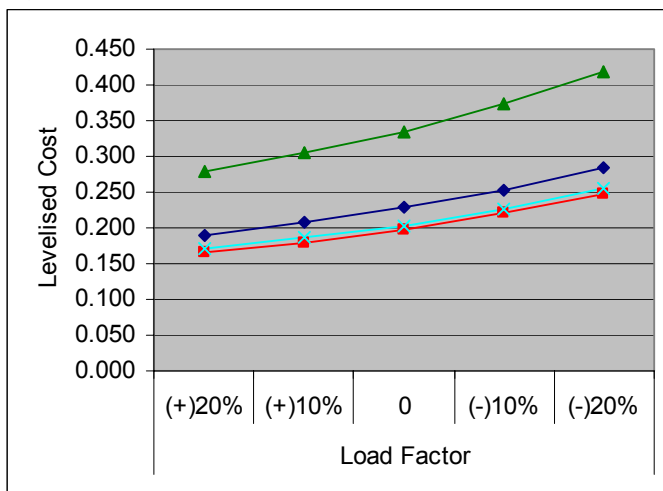


Figure 5: Variation of levelised cost with fuel cost

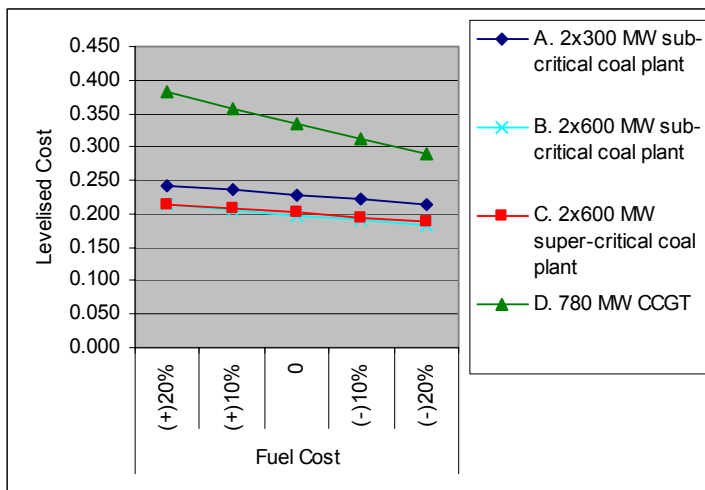

According to version 01 of AM0029, the baseline alternatives with the best financial indicator, i.e. the lowest levelised cost, can be selected as the most plausible scenario.

As can be seen above, even with changes in the critical variables of load factor and fuel cost, the 2x600 MW sub-critical coal-fired power plant has the lowest levelised cost. Therefore, the baseline selected is the 2x600 MW sub-critical coal-fired power plant.

B.5. Description of how the anthropogenic emissions of GHG by sources are reduced below those that would have occurred in the absence of the registered CDM project activity (assessment and demonstration of additionality): >>



The tool for the demonstration and assessment of additionality is used in AM0029⁹. The tool provides a set of steps to demonstrate and assess additionality. For AM0029, the following steps, with reference to the Taiyanggong CCGT project, are required:

Step 1: Benchmark Investment Analysis. This step consists of the additionality tool step 2, sub-step 2b (Option III: Apply benchmark analysis); sub-step 2c (Calculation and comparison of financial indicators) and sub-step 2d (Sensitivity analysis)

Step 2: Common practice analysis. This step consists of step 4 of the additionality tool

Step 3: Impact of CDM registration. This step consists of step 5 of the additionality tool

Step 1: Benchmark Investment Analysis

With reference to the Interim Rules on Economic Assessment of Electrical Engineering Retrofit Projects, issued by the former State Power Corporation of China, the benchmark IRR for this project is 8%¹⁰.

Calculations and comparison of financial indicators

(1) Basic parameters for calculation of financial indicators

Based on the feasibility study report of the proposed project, the basic parameters for the calculation of financial indicators are shown in the following table:

⁹ http://cdm.unfccc.int/methodologies/PAmethodologies/AdditionalityTools/Additionality_tool.pdf

¹⁰ State Power Corporation of China. Interim Rules on Economic Assessment of Electrical Engineering Retrofit Projects. Beijing: China Electric Power Press, 2003.

**Table 7: Main parameters and assumptions for investment analysis**

Parameter	Value	Unit	Source
installed capacity	780	MW	FSR
power generation	3,374,000	MWh	FSR
auxiliary electricity consumption rate	3.2%		FSR
net power generation	3,266,032	MWh	FSR
heat generation	5,885,000	GJ	FSR
construction period	2	years	FSR
operation period	20	year	FSR
electricity tariff (without tax)	411.02	RMB/MWh	Project owner
heat tariff (without tax)	23	RMB/ GJ	Project owner
gas price (without tax)	1.2865	RMB/ m3	Project owner
gas consumption pa	727,445,800	m3	FSR
Fixed assets	3,274,780,000	RMB	Project owner
Fixed assets residue	5%		FSR
Depreciation pa	6.33%		FSR
Depreciation period	15	years	FSR
Working capital	94,110,000	RMB	Project owner
Material expenditure	4.15	RMB/MWh	FSR
Other O&M expenditure	7.47	RMB/MWh	FSR
Water expenditure	1.8094	RMB/MWh	FSR
Overhaul of equipment	3%		FSR
Employee expenditure	15,400,000	RMB	FSR
City Maintenance & Construction tax	5.0%		FSR
Income tax	33%		FSR
CER crediting period	2008-12		Project owner
CER revenue pa	145,000,000	RMB	Project owner

(2) Comparison of IRR for the project and the financial benchmark

The financial indicators (IRR) with and without income from CERs sales as generated through the investment analysis are listed below. Without income from CERs sales, the IRR of the project activity is lower than the benchmark IRR, and the project activity is financially unacceptable. However, with income from CERs sales the project becomes financially attractive.

Table 8: Project IRR

	Without income from CERs	Benchmark	With income from CERs
IRR on total investment	7.63%	8.00%	9.12%

Sensitivity analysis


Three factors are considered in the following sensitivity analysis:

- 1) Heat sales price
- 2) Gas price

3) Load hours

Assuming the factors above vary in the range of -10% to +10%, without the revenue from CERs, the IRR of the total investment will change accordingly as can be seen in the figure below.

Figure 6: Sensitivity analysis

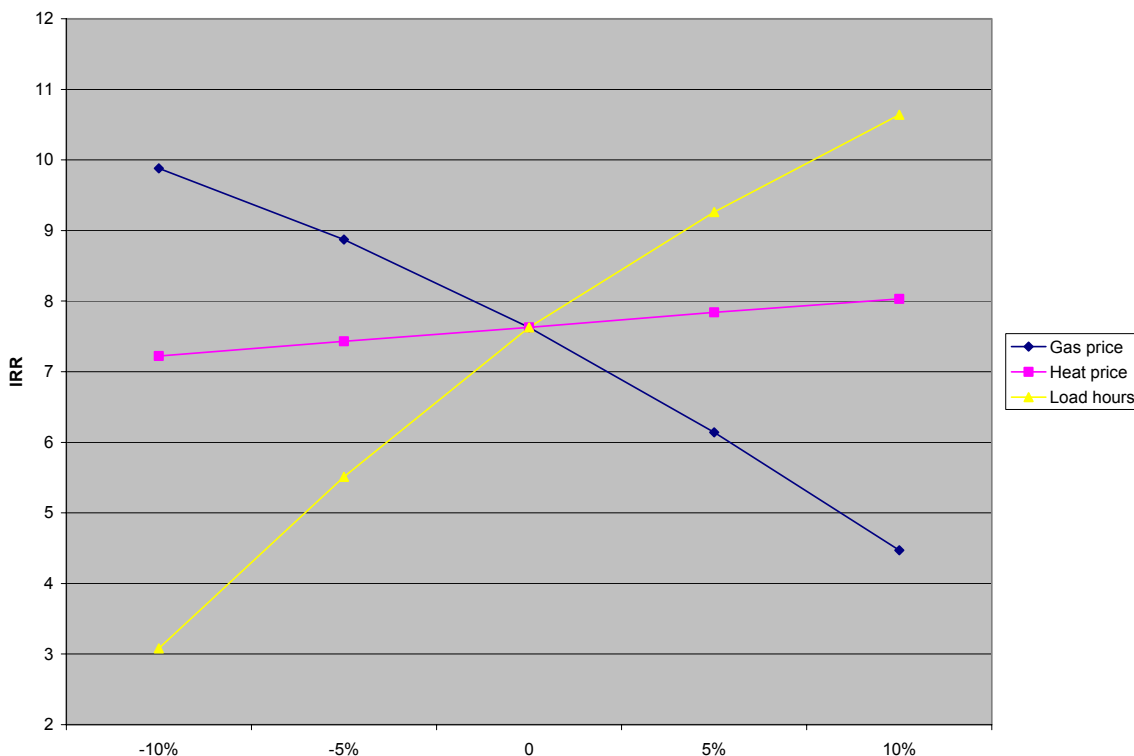

As can be seen in figure 6 above, there is very little impact on the IRR due to changes in the heat sales price for the project. Unless the heat sales price is increased by at least 10%, the IRR of the project activity remains lower than the benchmark, and is unlikely to be financially attractive.

Changes in gas price have a stronger impact on the IRR and if these costs decline, the IRR can increase to above the benchmark. However, it is unlikely that gas prices will fall over the course of the project as gas prices in China are currently rising and this trend is likely to continue as demand for natural gas increases.

Changes in the load hours and the amount of electricity generated also have a strong impact on the IRR, and if these increase, the IRR can pass the benchmark. However, it is unlikely that the electricity generated by the project will exceed the average annual expectation of 3,374,000 MWh, as the power output of the project is dependent on base load heat demand.



Based on the information above, the sensitivity analysis shows that with reasonable variations in critical assumptions, the IRR of the project activity remains lower than the benchmark, and is unlikely to be financially attractive without additional revenue from the sale of CERs.

Step 2: Common Practice Analysis

Sub-step a: Analyze other activities similar to the proposed project activity

Table 9: Other CCGT projects in the NCPN area

Location	Size	Details
Beijing	1 x 300MW	Jingfeng, Power only
Beijing	2 x 250MW	Zhengchangzhuang, CHP
Inner Mongolia	2 x 150MW	Sulige, Power only
Beijing	2 x 60MW	Yizhuang, CHP
Beijing	2 x 50MW	
Tianjin	1 x 56MW	

Sub-step b: Discuss any similar options that are occurring

From table 9 above, in the NCPG area, only the Zhengchangzhuang CCGT plant is of a similar size to the Tiyanggong plant. The Zhengchangzhuang plant is also in the process of applying for CDM registration. This demonstrates that all similar activities are also financially unattractive.

This project faces additional financial barriers (compared to other power plant projects of this scale) as it is located within a large city, and therefore additional investment is required. For example, this project faced additional costs in measures to reduce noise levels, installing de-nitrogenation equipment and ensuring safety and security in an urban environment.

In addition to being distinctive for its scale and siting in an urban area, the project activity is undertaking a certain amount of technological risk as it will use GE's PG9351 gas turbines that have not been used extensively in China. There is currently limited experience of operating and maintaining this type of turbine in China.

Step 3: Impact of CDM Registration

When the project activity is successfully approved and registered, the following positive benefits can be predicted:

1. The project will significantly reduce the emissions of the North China Power Grid while increasing capacity, voltage and peaking power.
2. The income from CERs sales will greatly improve the financial indicators of the project activity and increase the financial attractiveness of the project.
3. The use of new turbine technologies in China will lead to improved technical knowledge both on the part of those that are manufacturing the steam generators, and those that are operating and maintaining the overall power plant.



4. The project will set a benchmark for the use of low emission technologies in an urban area, with special consideration taken, and additional investment made, to ensure reduced noise and high levels of environmental protection on the construction and plant site.

It is only through the inclusion of CDM revenues that the project becomes financially attractive and the intention to register the project under the CDM was a determining factor in the decision to proceed with the project¹¹. It is therefore concluded that the project is not the baseline scenario and is additional.

B.6. Emission reductions:

B.6.1. Explanation of methodological choices:
--

According to AM0029 (version 01), the baseline emission factor (EF_y) can be calculated the following steps described as below:

Step 1: Calculating Baseline Emissions

Baseline emissions are calculated by multiplying the electricity generated in the project plant ($EG_{PJ,y}$) with a baseline CO_2 emission factor ($EF_{BL,CO_2,y}$), as follows:

$$BE_y = EG_{PJ,y} * EF_{BL,CO_2,y}$$

For construction of large new power capacity additions under the CDM, there is a considerable uncertainty relating to which type of other power generation is substituted by the power generation of the project plant. As a result of the project, the construction of an alternative power generation technology(s) could be avoided, or the construction of a series of other power plants could simply be delayed.

Furthermore if the project were installed sooner than these other projects might have been constructed, its near-term impact could be largely to reduce electricity generation in existing plants. This depends on many factors and assumptions (e.g. whether there is a supply deficit) that are difficult to determine and that change over time. In order to address this uncertainty in a conservative manner, the lowest emission factor from the following three options for $EF_{BL,CO_2,y}$ was used:

- Option 1. The build margin, calculated according to ACM0002; and
- Option 2. The combined margin, calculated according to ACM0002, using a 50/50 OM/BM weight.
- Option 3. The emission factor of the technology (and fuel) identified as the most likely baseline scenario under “Identification of the baseline scenario” above, and calculated as follows:

$$EF_{BL,CO_2} (tCO_2/MWh) = \frac{COEF_{BL}}{\eta_{BL}} * 3.6 \text{ GJ /MWh}$$

where,

¹¹ Beijing Taiyanggong Gas-fired Trigenation Power Project – Revised Financial Analysis and Feasibility Study Report, October 2005



$COEF_{BL}$: the fuel emission coefficient (tCO₂e/GJ), based on national average fuel data, if available, otherwise IPCC defaults can be used

η_{BL} : the energy efficiency of the technology, as estimated in the baseline scenario analysis above.

According to AM0029, the determination of the build margin and the combined margin will be made based on an ex ante assessment at validation and again at the start of each crediting period. Further, according to AM0029, if either option 1 (BM) or option 2 (CM) are selected as the baseline, they will be estimated ex post, as described in ACM0002.

Sub-step 1.1: Calculating the Operating Margin Emission Factor ($EF_{OM,y}$)

Four methods are suggested in ACM0002 for the calculation of the Operating Margin:

1. Simple OM;
2. Simple adjusted OM;
3. Dispatch data analysis OM; and
4. Average OM.

For this project, the Simple OM was calculated. This was the as only feasible option as:

- a) Dispatch data analysis OM (recommended as the first choice option) cannot be calculated as hourly dispatch data for all power plants in the top 10% of the grid system dispatch order is not made publicly available in China;
- b) Simple adjusted OM cannot be calculated for the same reason as above (unavailable data);
- c) Average OM calculation is not appropriate as the low-cost/must-run resources constitute less than 50% of the total grid generation, as demonstrated in Table 10 below.

Table 10: Power generation by sources in the NCPG over the past 5 more recent years

	Generation (2000) GWh		Generation (2001) GWh		Generation (2002) GWh		Generation (2003) GWh		Generation (2004) GWh	
	<i>China Electric Power Yearbook 2001, page 573</i>	%	<i>China Electric Power Yearbook 2002, page 617</i>	%	<i>China Electric Power Yearbook 2003, page 585</i>	%	<i>China Electric Power Yearbook 2004, page 709</i>	%	<i>China Electric Power Yearbook 2005, page 474</i>	%
Thermal	327,300	98.90%	358,066	99.19%	403,919	99.11%	457,675	99.14%	526,772	99.24%
Hydro	3,633	1.10%	2,927	0.81%	3,455	0.85%	3,798	0.82%	3,758	0.71%
Nuclear	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
Other (Wind)	0	0.00%	0	0.00%	170	0.04%	181	0.04%	274	0.05%
Total	330,932	100.00%	360,993	100.00%	407,544	100.00%	461,654	100.00%	530,804	100.00%

The operating margin (OM) is calculated for the generation mix of the NCPG, excluding zero-emission sources. Emissions of CO₂ for the generation mix of the NCPG can be directly calculated from the data provided in the China Energy Statistical Yearbook (published annually). This yearbook provides annual data on generation by fuel source and by province. The North China Power Grid, once zero emission sources have been removed, consists of thermal power plants, the vast majority of which are powered by coal.

***Sub-step 1.2: Calculating the Build Margin Emission Factor ($EF_{BM,y}$)***

The BM emissions factor ($EF_{BM,y}$) is the generation-weighted average emission factor (tCO₂/MWh) of a sample of power plants m , excluding power plant capacity additions registered as CDM project activities.

The Build Margin is calculated *ex-ante*, based on the most recent information available on plants already built at the time of PDD submission. As such the Build Margin emission factor will be constant throughout the selected crediting period. According to ACM0002 the sample group m could consist of either:

- the five power plants that have been built most recently, or
- the power plants capacity additions in the electricity system that comprise 20% of the system generation (in MWh) and that have been built most recently; whichever comprises the larger annual generation.

The calculation of the Build Margin for this project makes use of aggregated data to identify the 20% most recent capacity additions (sample group m). This was identified by direct comparison of the total installed capacity on the North China Power Grid in the most recent year where data is available, in this case 2004, and with historical data from preceding years until the 20% threshold is achieved (refer to Table A3 in Annex 3).

The percentage is calculated as follows:

$$\% \text{ Recent Capacity Additions} = [(C_{2004} - C_n) / C_{2004}] * 100$$

Where: C_{2004} is the capacity in 2004 (most recent year for which published data are available); and
 C_n is the capacity in the reference year n .

This provides the percentage of new capacity additions that have been added since year n .

It will not always be possible to determine exactly the most recent 20% of capacity additions from published sources. Therefore, in the interest of accuracy and of transparency, the year since which the new capacity additions relative to the current year amount to at least 20% of total current capacity is selected.

Comparing the installed capacity data from the latest China Electric Power Yearbook and from previous editions, it can be seen that the Build Margin is most accurately represented by new capacity added to the system since 2001. The vast majority of this new capacity was thermal power plant, with the remainder being hydro and wind¹².

¹² Comparing the installed capacity data for the years 2001 and 2004 from the relevant China Electric Power Yearbooks, it can be seen that 25.7% of new capacity was added to the system during this period. The new capacity was made up of new thermal (99.34%), hydro plant (0.11%) and wind (0.55%)



Following guidance issued by the CDM Executive Board in response to a request for guidance from an accredited DOE¹³ on the determination of the Build Margin in methodology AM0005 in China, $EF_{BM,y}$ is calculated as the capacity weighted average emissions factor of new installed capacity rather than the generation weighted factor. Furthermore, it is suggested in the same guidance note that the efficiency level of the best technology commercially available in the provincial/regional or national grid of China is used as a conservative proxy for each fuel type in estimating the fuel consumption when calculating the Build Margin. The suggested approach is followed in the determination of the Build Margin for the purposes of this project.

Sub-step 1.3: Calculating the Combined Margin Emission Factor (EF_{cm})

The combined margin emission factor (tCO_2/MWh) is calculated as the weighted average of the OM emission factor and the BM emission factor where the weights are w_{OM} and w_{BM} . The weighting of the OM and BM emissions factors used are the default values suggested by the AM00029 methodology as follows:

$$w_{OM} = 0.5$$

$$w_{BM} = 0.5$$

Sub-step 1.4: Calculating the emission factor of the baseline technology (EF_{BL})

The baseline technology is sub-critical coal (refer to section B4)

$$EF_{BL,CO_2} = (COEF_{BL} / \eta_{BL}) * 3.6$$

$$EF_{BL,CO_2} = 0.8731 \text{ tCO}_2 / \text{MWh}$$

Where;

$$\eta_{BL} = 39.01\%$$

Summary:

- $EF_{BM} = 0.8811 \text{ tCO}_2 / \text{MWh}$ (Option 1)
- $EF_{CM} = 0.9404 \text{ tCO}_2 / \text{MWh}$ (Option 2)
- $EF_{BL,CO_2} = 0.8731 \text{ tCO}_2 / \text{MWh}$ (Option 3)

According to AM0029, the lowest emission factor from EF_{BM} , EF_{CM} and EF_{BL,CO_2} is chosen. So in this case, EF_{BL} is used.

Step 2: Calculating project emissions (PEy)

¹³ DNV letter to the CDM Executive Board; *Request for Guidance: Application of AM0005 and AMS-I-D in China* dated 07/10/2005 available online at

<http://cdm.unfccc.int/UserManagement/FileStorage/6POIAMGYOEDOTKW25TA20EHEKPR4DM>



The project activity is on-site combustion of natural gas to generate electricity. On site combustion of diesel is also included in the project activity. This is used in additional generators to supply electricity to shut down turbines smoothly and safely. The CO₂ emissions from electricity generation were calculated as follows:

$$PE_y = \sum_t FC_{f,y} * COEF_{f,y}$$

Where:

$FC_{f,y}$: is the total volume of natural gas or other fuel 'f' combusted in the project plant or other startup fuel (m³ or similar) in year(s) 'y'

$COEF_{f,y}$: is the CO₂ emission coefficient (tCO₂/m³ or similar) in year(s) for each fuel and is obtained as:

$$COEF_{f,y} = \sum NCV_y * EFCO_{2,f,y} * OXID_f$$

Where:

$NCV_{gas,y}$: is the net calorific value (energy content) per volume unit of natural gas in year 'y' (GJ/m³) as determined from the fuel supplier, wherever possible, otherwise from local or national data;

$EFCO_{2,gas,y}$: is the CO₂ emission factor per unit of energy of natural gas in year 'y' (tCO₂/GJ) as determined from the fuel supplier, wherever possible, otherwise from local or national data;

$OXID_{gas}$: is the oxidation factor of natural gas

$NCV_{diesel,y}$: is the net calorific value (energy content) per volume unit of diesel in year 'y' (GJ/m³) as determined by the IPCC;

$EFCO_{2,diesel,y}$: is the CO₂ emission factor per unit of energy of diesel in year 'y' (tCO₂/GJ) as determined by the IPCC;

$OXID_{diesel}$: is the oxidation factor of diesel

Step 3: Calculating Leakage (LE_y)

According to AM00029, leakage may result from fuel extraction, processing, liquefaction, transportation, re-gasification and distribution of fossil fuels outside of the project boundary. This includes mainly fugitive CH₄ emissions and CO₂ emissions from associated fuel combustion and flaring. For this project, the following leakage emission source was considered:

- Fugitive CH₄ emissions associated with fuel extraction, processing, liquefaction, transportation, re-gasification and distribution of natural gas used in the project plant and fossil fuels used in the grid in the absence of the project activity.

Thus, leakage emissions were calculated using the following equation:

$$LE_y = LE_{CH_4,y}$$

where:

LE_y : Leakage emissions during the year y in tCO₂e



$LE_{CH_4,y}$: Leakage emissions due to fugitive upstream CH₄ emissions in the year y in tCO₂e

Fugitive methane emissions

For the purpose of estimating fugitive CH₄ emissions, the quantity of natural gas consumed by the project in year y was multiplied with an emission factor for fugitive CH₄ emissions ($EF_{NG,upstream,CH_4}$) from natural gas consumption and then the emissions occurring from fossil fuels used in the absence of the project activity subtracted, as follows:

$$LE_{CH_4,y} = [FC_y * NCV_y * EF_{NG,upstream,CH_4} - EG_{PJ,y} * EF_{BL,upstream,CH_4}] GWP_{CH_4}$$

where:

$LE_{CH_4,y}$: Leakage emissions due to fugitive upstream CH₄ emissions in the year y in tCO₂e

FC_y : Quantity of natural gas combusted in the project plant during the year y in m³

$NCV_{NG,y}$: Average net calorific value of the natural gas combusted during the year y in GJ/m³

$EF_{NG,upstream,CH_4}$: Emission factor for upstream fugitive methane emissions of natural gas from production, transportation, distribution, in tCH₄ per GJ fuel supplied to final consumers

$EG_{PJ,y}$: Electricity generation in the project plant during the year in MWh

$EF_{BL,upstream,CH_4}$: Emission factor for upstream fugitive methane emissions occurring in the absence of the project activity in tCH₄ per MWh electricity generation in the project plant, as defined below

GWP_{CH_4} : Global warming potential of methane valid for the relevant commitment period

According to AM0029, the emission factor for upstream fugitive CH₄ emissions occurring in the absence of the project activity ($EF_{BL,upstream,CH_4}$) should be calculated consistent with the baseline emission factor (EF_{BL,CO_2}) used above. In the case of this project, the lowest emission factor was ‘option 3’. Therefore, the following equation was used to calculate the upstream fugitive CH₄ emissions occurring in the absence of the project activity:

$$EF_{BL,upstreamCH_4} = \frac{EF_{k,upstream,CH_4}}{\eta_{BL}} * 3.6 \text{ GJ /MWh}$$

where:

$EF_{BL,upstream,CH_4}$: Emission factor for upstream fugitive methane emissions occurring in the absence of the project activity in t CH₄ per MWh electricity generation in the project plant

$EF_{k,upstream,CH_4}$: Emission factor for upstream fugitive methane emissions from production of the fuel type k (a coal or oil type) in t CH₄ per MJ fuel produced

η_{BL} Energy efficiency of the most likely baseline technology

Step 4: Emissions Reductions

To calculate the emission reductions, the following equation was applied:

$$ER_y = BE_y - PE_y - LE_y$$

Where:

ER_y : emissions reductions in year y (t CO₂e)

BE_y : emissions in the baseline scenario in year y (t CO₂e)



PE_y : emissions in the project scenario in year y (t CO₂e)

LE_y : leakage in year y (t CO₂e)

B.6.2. Data and parameters that are available at validation:

Data / Parameter:	EF_{CO₂,gas}
Data unit:	tCO ₂ /GJ
Description:	The CO ₂ emission factor per unit of energy of natural gas
Source of data used:	IPCC default value in 2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Value applied:	0.0561
Justification of the choice of data or description of measurement methods and procedures actually applied :	No country default value available, IPCC default value used.
Any comment:	

Data / Parameter:	OXID_{gas}
Data unit:	-
Description:	The oxidation factor of natural gas
Source of data used:	IPCC default value in 2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Value applied:	1
Justification of the choice of data or description of measurement methods and procedures actually applied :	No country default value available, IPCC default value used.
Any comment:	

Data / Parameter:	NCV_{diesel}
Data unit:	TJ/Gg
Description:	Net calorific value (energy content) per unit of diesel
Source of data used:	IPCC default value in 2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Value applied:	43.00
Justification of the choice of data or description of measurement methods and procedures actually applied :	According to AM0029, IPCC default calorific values are acceptable, if local or national estimates are unavailable
Any comment:	



Data / Parameter:	EF_{CO₂,diesel}
Data unit:	tCO ₂ /GJ
Description:	The CO ₂ emission factor per unit of energy of diesel
Source of data used:	IPCC default value in 2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Value applied:	0.0741
Justification of the choice of data or description of measurement methods and procedures actually applied :	No country default value available, IPCC default value used.
Any comment:	

Data / Parameter:	OXID_{diesel}
Data unit:	-
Description:	The oxidation factor of diesel
Source of data used:	2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Value applied:	1
Justification of the choice of data or description of measurement methods and procedures actually applied :	No country default value available, IPCC default value used.
Any comment:	

Data / Parameter:	EF_{OM}
Data unit:	tCO ₂ / MWh
Description:	Operating Margin Emission Factor
Source of data used:	Own calculation based on data supplied in the China Electric Power Yearbook
Value applied:	0.9997 tCO ₂ / MWh
Justification of the choice of data or description of measurement methods and procedures actually applied :	Emission factor calculated <i>ex ante</i> according to the methodology presented in ACM0002: “Consolidated baseline methodology for grid-connected electricity generation from renewable sources” (ACM0002/ Version 06, Sectoral Scope: 1, 19 May 2006)
Any comment:	-

Data / Parameter:	EF_{BM}
Data unit:	tCO ₂ / MWh
Description:	Build Margin Emission Factor
Source of data used:	Own calculation based on data supplied in the China Electric Power Yearbook
Value applied:	0.8811 tCO ₂ / MWh
Justification of the choice of data or	Emission factor calculated <i>ex ante</i> as weighted average emission factor of the 20% most recent power plants built according to the methodology presented in



CDM – Executive Board

page 26

description of measurement methods and procedures actually applied :	ACM0002: “Consolidated baseline methodology for grid-connected electricity generation from renewable sources” (ACM0002/ Version 06, Sectoral Scope: 1, 19 May 2006) and DNV letter to the CDM Executive Board; <i>Request for Guidance: Application of AM0005 and AMS-I-D in China</i> dated 07/10/2005
Any comment:	-

Data / Parameter:	NCV_{coal}
Data unit:	GJ/t _{SCE}
Description:	Net calorific value of coal
Source of data used:	The General Code for Comprehensive Energy Consumption Calculation (Chinese National Standard GB2589-90)
Value applied:	29.3
Justification of the choice of data or description of measurement methods and procedures actually applied :	Chinese National Standard value
Any comment:	-

Data / Parameter:	OXID_{coal}
Data unit:	-
Description:	The oxidation factor of coal
Source of data used:	2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Value applied:	1
Justification of the choice of data or description of measurement methods and procedures actually applied :	No country default value available, IPCC default value used.
Any comment:	-

Data / Parameter:	COEF_{BL}
Data unit:	tCO ₂ /GJ
Description:	Fuel emission co-efficient for coal
Source of data used:	2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Value applied:	0.0946
Justification of the choice of data or description of measurement methods and procedures actually applied :	No country default value available, IPCC default value used.
Any comment:	-

Data / Parameter:	η_{BL}
--------------------------	-----------------------



CDM – Executive Board

Data unit:	-
Description:	Baseline scenario efficiency
Source of data used:	Calculated according to AM00029
Value applied:	39%
Justification of the choice of data or description of measurement methods and procedures actually applied :	Baseline technology determined in section B4 above and based on data supplied in the China Institute of Power Planning and Design, Thermal Power Engineering Design Reference Cost Index, 2005 edition
Any comment:	

Data / Parameter:	EF_{NGupstream,CH4}
Data unit:	tCH ₄ / PJ
Description:	Emission factor for upstream fugitive methane emissions of natural gas from production, transportation and distribution
Source of data used:	IPCC default value ¹⁴
Value applied:	296
Justification of the choice of data or description of measurement methods and procedures actually applied :	This data is based on the IPCC default value, according to AM0029.
Any comment:	-

Data / Parameter:	EF_{BL,upstream,CH4}
Data unit:	tCH ₄ / kt coal used
Description:	Emission factor for upstream fugitive methane emissions occurring in the absence of the project activity
Source of data used:	IPCC default value ¹⁵
Value applied:	13.4
Justification of the choice of data or description of measurement methods and procedures actually applied :	This data is based on the IPCC default value, according to AM0029.
Any comment:	-

Data / parameter:	GWP_{CH4}
Data unit:	tCO ₂ e/tCH ₄
Description:	Global warming potential for CH ₄ .

¹⁴ Volume 3 of the 1996 Revised IPCC Guidelines Table 1-63 and 1-64, p1.130 and p1.131

¹⁵ Volume 3 of the 1996 Revised IPCC Guidelines Equations 1 and 4, p.1.105 and 1.110



Source of data used:	UNFCCC
Value applied:	21
Justification of the choice of data or description of measurement methods and procedures actually applied :	21 for the first commitment period. Shall be updated according to any future COP/MOP decisions.
Any comment:	-

B.6.3 Ex-ante calculation of emission reductions:

(Refer also to Annex 3)

Step 1: Calculating project emissions (PEy)

For combusted gas,

$$\text{COEF}_{\text{gas}} = \text{NCV}_{\text{gas}} * \text{EFCO}_{2,\text{gas}} * \text{OXID}_{\text{gas}}$$

$$\text{COEF}_{\text{gas}} = 0.0018 \text{ tCO}_2/\text{m}^3$$

$$\text{PE}_{\text{gas}} = \text{FC}_{\text{gas}} * \text{COEF}_{\text{gas}}$$

$$\text{PE}_{\text{gas}} = 1,340,735 \text{ tCO}_2$$

Where:

$$\text{NCV}_{\text{gas}} = 0.0327 \text{ GJ}/\text{m}^3$$

$$\text{EFCO}_{2,\text{gas}} = 0.0561 \text{ tCO}_2/\text{GJ}$$

$$\text{OXID}_{\text{gas}} = 1$$

$$\text{FC}_{\text{gas}} = 730,410,000 \text{ m}^3$$

For diesel,

$$\text{COEF}_{\text{diesel}} = \text{NCV}_{\text{diesel}} * \text{EFCO}_{2,\text{diesel}} * \text{OXID}_{\text{diesel}}$$

$$\text{COEF}_{\text{diesel}} = 3.1849 \text{ tCO}_2/\text{tonne}$$

$$\text{PE}_{\text{diesel}} = \text{FC}_{\text{diesel}} * \text{COEF}_{\text{diesel}}$$

$$\text{PE}_{\text{diesel}} = 24.4617 \text{ tCO}_2$$

Where :



$$NCV_{\text{diesel}} = 43.00 \text{ GJ/ tonne}$$

$$EFCO_{2,\text{diesel}} = 0.0741 \text{ tCO}_2/\text{ GJ}$$

$$OXID_{\text{diesel}} = 1$$

$$FC_{\text{diesel}} = 7.6806 \text{ tonnes}$$

$$PE_y = 1,340,735 + 24.4617$$

$$PE_y = 1,340,759 \text{ tCO}_2$$

Step 2: Calculating Baseline emissions (BE_y)

Calculating Baseline emissions

As discussed in section B6.1 above,

$$EF_{\text{BL,CO}_2} = 0.8731 \text{ tCO}_2/\text{ MWh (Option 3)}$$

Therefore:

$$BE_y = EG_{\text{PJ,y}} * EF_{\text{BM}}$$

$$BE_y = 2,851,607 \text{ tCO}_2$$

Where:

$$EG_{\text{PJ,y}} = 3,266,032 \text{ MWh}$$

Step 3: Calculating Leakage (LE_y)

For baseline option 3,

$$EF_{\text{BL,upstreamCH}_4} = \frac{EF_{\text{k, upstream,CH}_4}}{\eta_{\text{BL}}} * 3.6 \text{ GJ /MWh}$$

$$EF_{\text{BL,upstreamCH}_4} = 0.0005 \text{ tCH}_4/\text{ GJ}$$

Where:

$$EF_{\text{k, upstream,CH}_4} = 13.4 \text{ tCH}_4/\text{ kt coal}$$

$$\eta_{\text{BL}} = 39.01\%$$

$$LE_{\text{CH}_4,y} = [FC_y * NCV_y * EF_{\text{NG,upstream,CH}_4} - EG_{\text{PJ,y}} * EF_{\text{BL,upstream,CH}_4}] * GWP_{\text{CH}_4}$$

$$LE_{\text{CH}_4,y} = -140,958 \text{ tCO}_2\text{e}$$



Where:

$$FC_{\text{gas}} = 730,410,000 \text{ m}^3$$

$$NCV_{\text{gas}} = 0.0327 \text{ GJ/m}^3$$

$$EF_{\text{NG,upstream,CH}} = 296 \text{ tCH}_4/\text{PJ}$$

$$EG_{\text{PJ,y}} = 3,266,032 \text{ MWh}$$

$$GWP_{\text{CH}_4} = 21 \text{ tCO}_2\text{e/tCH}_4$$

According to AM0029, where total net leakage effects are negative ($LE_y < 0$), project participants should assume $LE_y = 0$.

Therefore for the Project

$$LE_y = 0$$

Step 4: Calculating Emission Reductions

$$ER_y = BE_y - PE_y - LE_y$$

$$ER_y = 1,510,848 \text{ tCO}_2$$

B.6.4 Summary of the ex-ante estimation of emission reductions:

Year	Estimation of project activity emissions (tonnes of CO ₂ e)	Estimation of baseline emissions (tonnes of CO ₂ e)	Estimation of leakage (tonnes of CO ₂ e)	Estimation of overall emissions reductions (tonnes of CO ₂ e)
2007 (1.5 months)	167,595	356,451	0	188,856
2008	1,340,759	2,851,607	0	1,510,848
2009	1,340,759	2,851,607	0	1,510,848
2010	1,340,759	2,851,607	0	1,510,848
2011	1,340,759	2,851,607	0	1,510,848
2012	1,340,759	2,851,607	0	1,510,848
2013	1,340,759	2,851,607	0	1,510,848
2014 (10.5 months)	1,173,164	2,495,157	0	1,321,992
Total (tonnes of CO₂e)	9,385,315	19,961,252	0	10,575,938

B.7 Application of the monitoring methodology and description of the monitoring plan:



B.7.1 Data and parameters monitored:	
Data / Parameter:	FC_{gas}
Data unit:	m ³
Description:	Annual natural gas consumption
Source of data to be used:	The consumption of natural gas will be monitored and recorded by the project participants
Value of data applied for the purpose of calculating expected emission reductions in section B.5	730,410,000
Description of measurement methods and procedures to be applied:	Natural gas consumption will be monitored and cross-checked using sales receipts from the gas supply company
QA/QC procedures to be applied:	The quality assurance and quality control procedures for recording, processing and archiving data will be followed and improved for this CDM project activity according to EB rules and requirement to allow easy verification of the emission reductions on an annual basis.
Any comment:	-

Data / Parameter:	FC_{diesel}
Data unit:	Tonnes
Description:	Annual diesel consumption
Source of data to be used:	The consumption of diesel will be calculated and recorded by the project participants
Value of data applied for the purpose of calculating expected emission reductions in section B.5	7.6806
Description of measurement methods and procedures to be applied:	Diesel consumption will be monitored and cross-checked using sales receipts from the diesel supply company
QA/QC procedures to be applied:	The quality assurance and quality control procedures for recording, processing and archiving data will be followed and improved for this CDM project activity according to EB rules and requirement to allow easy verification of the emission reductions on an annual basis.
Any comment:	-

Data / Parameter:	EG_v
Data unit:	MWh
Description:	Electricity supplied to the grid by the project net of any on-site parasitic usage
Source of data to be used:	The kWh output from the project will be monitored and recorded.



Value of data applied for the purpose of calculating expected emission reductions in section B.5	3,266,032
Description of measurement methods and procedures to be applied:	EGy will be monitored automatically by the project participant and will be cross-checked using electricity sales invoices. EG _y data will be aggregated monthly and presented as a summary in the annual monitoring report.
QA/QC procedures to be applied:	The quality assurance and quality control procedures for recording, processing and archiving data will be followed and improved for this CDM project activity according to EB rules and requirement to allow easy verification of the emission reductions on an annual basis.
Any comment:	-

Data / Parameter:	NCV_{gas}
Data unit:	GJ/m ³
Description:	Net calorific value (energy content) per volume unit of natural gas
Source of data to be used:	The NCV of the gas supplied to the project will be measured periodically
Value of data applied for the purpose of calculating expected emission reductions in section B.5	0.0327
Description of measurement methods and procedures to be applied:	Fuel sampling and calculating of the NCV of the gas supplied will be the responsibility of the gas supply company.
QA/QC procedures to be applied:	The quality assurance and quality control procedures for recording, processing and archiving data will be followed and improved for this CDM project activity according to EB rules and requirement to allow easy verification of the emission reductions on an annual basis.
Any comment:	-

B.7.2 Description of the monitoring plan:

Refer also to annex 4

CDM Project Management and Calculations


The project sponsor will establish a CDM office which will be responsible for monitoring project emissions and other CDM related activities. An organisation chart is illustrated below. The meter reader will be responsible for compiling meter readings regularly and ensuring that the parameters identified in B7.1 are monitored. The meter reader will then send these records to the auditor who will ensure that they correspond to third party records (e.g. meter readings by the grid company or gas supply company). Any discrepancies will be reported to the office head and general manager. Following this cross-

checking procedure, the readings will be stored electronically in the CDM information management system.

The calibration and maintenance of the meters will be the responsibility of the quality supervisor. The quality supervisor will supervise meter maintenance and manage the calibration process according to the company's quality control programme.

To ensure that this monitoring plan is fully implemented, a CDM manual will be prepared giving full instructions for implementation. In addition, responsibility will be assigned to an individual (the CDM project officer) in the CDM office to prepare the monitoring report for verification by the DoE and issuance of CERs.

Figure 7: CDM Responsibility table

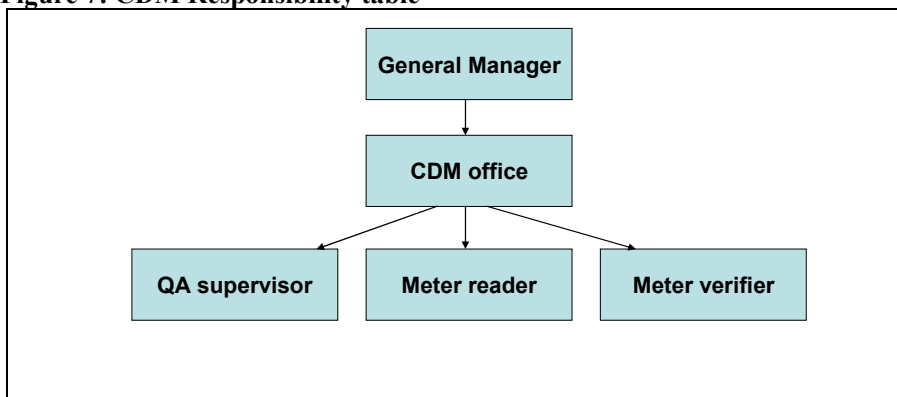

Procedures to be followed

A detailed monitoring plan will be developed in accordance with the company's management system.

Gas consumption monitoring

- There are three meters monitoring gas consumption: one measuring gas to each compressor and a third meter as back-up
- As a further back-up, receipts of gas supplied by the gas company will be used.

Monitoring of electricity generated

- There are 2 connections to the 220kV Beijing Power Grid, each with a meter (m_4 and m_5). These meters will measure total electricity sent to the grid.
- Each of the 3 electricity producing generators has a meter to monitor the electricity produced and sent to the main internal line (m_1 , m_2 and m_3). On-site, auxiliary use of power generated is measured by a separate meter (m_a). Back up readings will be taken from these meters
- Finally, there are two meters (m_x and m_z) owned by the Beijing Power grid company measuring the electricity supplied to the grid from the project. Readings from these will be used as a further back-up.



In summary,

$$\text{Net electricity generated} = m_4 + m_5 = (m_1 + m_2 + m_3) - m_a = m_x + m_z$$

Monitoring of diesel consumption

- The diesel generators will be used in an emergency only to supply electricity to shutdown turbines smoothly and safely. They will also be tested once a week.
- Because of this intermittent use, a flow meter is not appropriate to measure diesel consumption. Instead, diesel consumption will be calculated based on rated capacity, operating hours and generator efficiency.

B.8 Date of completion of the application of the baseline study and monitoring methodology and the name of the responsible person(s)/entity(ies)

Date of completion of the baseline study and monitoring methodology: 22 January 2007

Rachel Child Camco International Ltd. Suite 906 Lucky Tower A No.3 North Road East 3 rd Ringroad Chaoyang District Beijing 100027 China	Tel: +8610 84483025 Fax: +8610 8448 2499 Email: rachel@camco-international.com.cn Website: www.camco-international.com
--	---

**SECTION C. Duration of the project activity / crediting period.****C.1 Duration of the project activity:****C.1.1. Starting date of the project activity:**

13 July 2006

C.1.2. Expected operational lifetime of the project activity:

30 years

C.2 Choice of the crediting period and related information:**C.2.1. Renewable crediting period****C.2.1.1. Starting date of the first crediting period:**

15 November 2007

C.2.1.2. Length of the first crediting period:

7 years

C.2.2. Fixed crediting period:**C.2.2.1. Starting date:**

n/a

C.2.2.2. Length:

n/a

SECTION D. Environmental impacts**D.1. Documentation on the analysis of the environmental impacts, including transboundary impacts:**

An Environmental Impact Assessment for the project was carried out by Guodian North China Power Engineering (Beijing) Co., Ltd., and was approved by the Beijing Environmental Protection Bureau in June 2006.

A summary of the impacts is presented below:



Impacts on air quality: this project will lead to an improvement in air quality as natural gas (considered a clean fuel) will be burned and a dry-type low-nitrogen burner will be installed. It is predicated that SO₂ and NO_x emission concentration will be 0.65 mg/m³ and 150 mg/m³ once the plant is put into operation, which is 3.25% and 75% of Beijing's emission standards¹⁶ respectively, and the total emissions will be 3.52 tonnes per day of SO₂ and 813.1 tonnes of NO_x.

Measures to prevent water pollution: the following procedures will be followed:

- the cooling water used in this project is treated water from the municipal waste water treatment plant. Using this water helps to decrease freshwater consumption and also reduces the quantity of waste water.
- rainwater in the plant area and any excess water from the circulating cooling water will be discharged into the urban rainwater pipeline network;
- industrial waste water will generally be recycled after treatment, with a small amount of waste water entering the urban sewage pipeline network after treatment;
- domestic sewage will be discharged into the urban sewage pipeline network after primary treatment.

Therefore, the discharge of waste water from this project is in full compliance with national and local waste water requirements

Measures to control noise pollution: the principal environmental problem anticipated from this project is noise from, in particular, the gas turbine and mechanical draft cooling tower. A series of measures will be undertaken to control the noise level of the project including:

- controlling the noise from equipment and the installation of a silencer;
- optimizing the general layout of the site so as to arrange noisy equipment indoors,
- improving the sound-proofing installed

The target noise level from the project is 55dB in the daytime and 48dB at night. This is fully in compliance with national and local requirements

D.2. If environmental impacts are considered significant by the project participants or the host Party, please provide conclusions and all references to support documentation of an environmental impact assessment undertaken in accordance with the procedures as required by the host Party:

The impacts on the environment are not considered significant

SECTION E. Stakeholders' comments

E.1. Brief description how comments by local stakeholders have been invited and compiled:

An open public meeting was held on Wednesday 18 October 2006 in the meeting room of Beijing Taiyanggong Gas-fired Thermal Power Co. Ltd. There were a total of 57 people at the meeting including:

- representatives from Beijing City Environment Protection Bureau
- representatives from Beijing Chaoyang District Environment Protection Bureau
- representatives from Beijing City Taiyanggong Village Government

¹⁶ Boiler pollutant total discharge standards (DB11/139-2002)



- local residents

The meeting was composed of three main parts:

1. Wang Jian, the manager of the team in charge of the project gave an introduction to the Beijing Taiyanggong CCGT Trigeneration CDM Project including:
 - The technological process that will be followed by the project for generating electricity with natural gas and supplying heating and cooling;
 - General information about the project including the installed capacity and investment etc.;
2. Opportunity for those attending the meeting to ask any questions they have about the project or to raise any concerns about it
3. Completion of a questionnaire to capture the views of those attending the meeting on the project

E.2. Summary of the comments received:

Those attending the meeting said unanimously that they support the construction of the project. In particular, it was recognised that the project, by using natural gas, will improve the air quality of the local area.

Other questions were raised about the potential for noise pollution and water pollution that could arise from the project.

A total of 57 questionnaires were completed and the results are summarised below:

- 56 respondents thought this project was important
- All 57 respondents agreed with the construction of this project
- 49 respondents thought that the local environment would be improved by this project
- 50 respondents thought that the project would have a positive benefit on the local environment

E.3. Report on how due account was taken of any comments received:

The comments and questions raised were responded to as follows:

- Impact on the local environment - the fuel to be used in this project is natural gas which is a clean source of energy. The use of natural gas can reduce emissions of air pollutants, improve the air quality of the local area and increase energy utilization efficiency. It is an environmentally friendly source of energy and its use is in accordance with national guidelines for energy saving and sustainable development.
- Noise pollution – An extra 171 million RMB has been invested in measures to reduce noise levels from the project and to ensure that the noise levels of the plant site do not exceed 55db in the daytime and 45db at night. For example, special designs were used for the waste water treatment building and other buildings to reduce noise and noise proofing materials were used where appropriate. Further, the project company has adopted measures to avoid disturbing near-by residents such as arranging the



transportation of materials to and from the site to take place during the day so as to avoid disturbing the sleep of local residents.

- Water resources – treated water from the City Sewage Water Treatment Plant will be used for cooling water for the power plant. This can help to save water resources and is in accordance with national industry policy. Water from the power plant will be discharged into the city’s sewage system and prior to this, treatment at the plant will follow the “Beijing City Water Pollutants Discharge Standard (Trial Version)”.

**Annex 1****CONTACT INFORMATION ON PARTICIPANTS IN THE PROJECT ACTIVITY**

Organization:	Beijing Taiyanggong Gas-fired Thermal Power Co. Ltd.
Street/P.O.Box:	No. 98 North Village, Taiyanggong District
Building:	
City:	Beijing
State/Region:	
Postfix/ZIP:	100102
Country:	P.R. China
Telephone:	010-52036023
FAX:	010-52036008
E-Mail:	
URL:	
Represented by:	Song Hui
Title:	Project Manager
Salutation:	Miss
Last Name:	Song
Middle Name:	
First Name:	Hui
Department:	Planning and Financial Department
Mobile:	138 1038 3527
Direct FAX:	010 5203 6008
Direct tel:	010 5203 6023
Personal E-Mail:	songh@bjsunhouse.com

Organization:	Camco International Limited
Street/P.O.Box:	
Building:	1 Regent Street
City:	London
State/Region:	
Postfix/ZIP:	SW1Y 4NW
Country:	United Kingdom
Telephone:	+86 10 8448 1385
FAX:	+86 10 8448 2499
E-Mail:	info@camco-international.com
URL:	www.camco-international.com
Represented by:	
Title:	Mr
Salutation:	Manager
Last Name:	Graham
Middle Name:	
First Name:	James



CDM – Executive Board

page 40

Department:	
Mobile:	
Direct FAX:	As Above
Direct tel:	As Above
Personal E-Mail:	James.graham@camco-international.com

Organization:	Macquarie Bank Limited
Street/P.O.Box:	Level 35, Citypoint
Building:	1, Ropemaker Street
City:	London
State/Region:	
Postfix/ZIP:	EC2Y 9HD
Country:	United Kingdom
Telephone:	+44 207 065 2000
FAX:	+44 207 065 2115
E-Mail:	john.marlow@macquarie.com
URL:	www.macquarie.com
Represented by:	John Marlow
Title:	Head of Environmental Financial Products
Salutation:	Mr
Last Name:	Marlow
Middle Name:	
First Name:	John
Department:	Treasury & Commodities Group
Mobile:	+44 7786 362 069
Direct FAX:	+44 207 065 2115
Direct tel:	+44 207 065 2371
Personal E-Mail:	john.marlow@macquarie.com



Annex 2

INFORMATION REGARDING PUBLIC FUNDING

There are no public funds involved in the project activity.

.



Annex 3

BASELINE INFORMATION



CDM – Executive Board

Table A1: Project emissions

Data type	ID number	Value	Unit	Source
Gas				
Net Calorific Value	NCV _{gas}	0.0327	GJ/m ³	Taiyanggong Feasibility Study Report
Emission Factor		15.3	kgC/GJ	2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Emission Factor	EF _{CO2, gas}	0.0561	tCO ₂ / GJ	
Oxidation factor	OXID _{gas}	1.0000		2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
CO ₂ emission co-efficient	COEF _{gas}	0.0018	tCO ₂ / m ³	Calculated
Annual gas consumption	FC _{gas}	730,410,000	m ³	Taiyanggong Feasibility Study Report
Annual emissions due to gas combustion	PE_{gas}	1,340,735	tCO₂	
Diesel				
Net Calorific Value		43.00	TJ/ Gg	2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Net Calorific Value	NCV _{diesel}	43.00	GJ/ tonne	
Emission Factor		20.20	kg/ GJ	2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Emission Factor	EF _{CO2, diesel}	0.0741	tCO ₂ / GJ	
Oxidation factor	OXID _{diesel}	1.0000		2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
CO ₂ emission co-efficient	COEF _{diesel}	3.1849	tCO ₂ / tonne	Calculated
Annual diesel consumption	FC _{diesel}	7.6806	tonnes	Estimated (based on diesel generators (2 x 800kW, 90% efficiency) both operating for 1 hour per week, 52 weeks and a calorific value for diesel of 43.33 GJ/ tonne)
Annual emissions due to diesel	PE_{diesel}	24.4617	tCO₂	
Total project emissions		1,340,759	tCO₂e	



Table A2: Operating Margin

2002 Fuel	Unit	Total Fuel NCPN	Beijing	Tianjing	Hebei	Shanxi	Inner		Unit	Total Fuel NCPN	Emission factor (tC/			CO2e (tonnes)
							Mongolia	Shandong			TJ)	NCV	Oxidation	
Coal	x10(4) tn	19150.84	691.84	1052.74	4988.01	4037.39	3218.00	5162.86	t	191,508,400	25.8	20.91	1.000	378,783,852
Cleaned coal	x10(4) tn	80.71	0.00	0.00	0.00	0.00	0.00	80.71	t	807,100	25.8	26.34	1.000	2,011,103
Other washed coal	x10(4) tn	310.51	3.43	0.00	65.20	135.56	0.00	106.32	t	3,105,100	25.8	9.41	1.000	2,764,117
Coke	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	0.00	t	0	29.2	28.44	1.000	0
Coke oven gas	x10(8) m3	2.83	0.17	1.71	0.00	0.75	0.16	0.04	m3	28,300	12.1	17.35	1.000	21,784
Other gas	x10(8) m3	33.51	15.82	0.00	7.34	0.00	10.35	0.00	m3	335,100	12.1	16.97	1.000	252,298
Other coking products	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	0.00	t	0	29.2	28.44	1.000	0
Crude oil	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	0.00	t	0	20	41.82	1.000	0
Gasoline	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	0.00	t	0	18.9	43.07	1.000	0
Diesel oil	x10(4) tn	18.35	0.26	2.35	4.12	0.00	1.60	10.02	t	183,500	20.2	42.65	1.000	579,693
Fuel oil	x10(4) tn	35.95	13.94	0.04	1.22	0.00	0.42	20.33	t	359,500	21.1	41.82	1.000	1,163,042
LPG	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	0.00	t	0	17.2	50.18	1.000	0
Refinery gas	x10(4) tn	0.27	0.00	0.00	0.27	0.00	0.00	0.00	t	2,700	15.7	46.06	1.000	7,158
Natural gas	x10(8) m3	0.57	0.00	0.55	0.00	0.00	0.02	0.00	m3	5,700	15.3	38.93	1.000	12,449
Other energy (e.g. renewables or waste heating)	x10(4) tce	0.00	0.00	0.00	0.00	0.00	0.00	0.00	tce	0	0	29.27	1.000	0

Total emissions of China Northern Power Grid (tCO2e) 385,595,494.86

Fossil based electricity delivered to the China Northern Power Grid (TWh) 398.89

OM emissions factor of the China Northern Power Grid (tCO2e/MWh) 0.9667

2003 Fuel	Unit	Total Fuel NCPN	Beijing	Tianjing	Hebei	Shanxi	Inner		Unit	Total Fuel NCPN	Emission factor (tC/			CO2e (tonnes)
							Mongolia	Shandong			TJ)	NCV	Oxidation	
Coal	x10(4) tn	22535.94	714.73	1052.74	5482.64	4528.51	3949.32	6808.00	t	225,359,400	25.8	20.91	1.000	445,737,636
Cleaned coal	x10(4) tn	9.41	0.00	0.00	0.00	0.00	0.00	9.41	t	94,100	25.8	26.34	1.000	234,475
Other washed coal	x10(4) tn	732.70	6.31	0.00	67.28	208.21	0.00	450.90	t	7,327,000	25.8	9.41	1.000	6,522,393
Coke	x10(4) tn	2.80	0.00	0.00	0.00	0.00	2.80	0.00	t	28,000	29.2	28.44	1.000	85,244
Coke oven gas	x10(8) m3	3.08	0.24	1.71	0.00	0.90	0.21	0.02	m3	30,800	12.1	17.35	1.000	23,709
Other gas	x10(8) m3	39.43	16.92	0.00	10.63	0.00	10.32	1.56	m3	394,300	12.1	16.97	1.000	296,869
Other coking products	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	0.00	t	0	29.2	28.44	1.000	0
Crude oil	x10(4) tn	29.68	0.00	0.00	0.00	0.00	0.00	29.68	t	296,800	20	41.82	1.000	910,139
Gasoline	x10(4) tn	0.01	0.00	0.00	0.00	0.00	0.00	0.01	t	100	18.9	43.07	1.000	298
Diesel oil	x10(4) tn	13.95	0.29	1.35	4.00	0.00	2.91	5.40	t	139,500	20.2	42.65	1.000	440,693
Fuel oil	x10(4) tn	25.80	13.95	0.02	1.11	0.00	0.65	10.07	t	258,000	21.1	41.82	1.000	834,672
LPG	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	0.00	t	0	17.2	50.18	1.000	0
Refinery gas	x10(4) tn	1.10	0.00	0.00	0.27	0.00	0.00	0.83	t	11,000	15.7	46.06	1.000	29,164
Natural gas	x10(8) m3	1.58	0.00	0.50	0.00	0.00	0.00	1.08	m3	15,800	15.3	38.93	1.000	34,508
Other energy (e.g. renewables or waste heating)	x10(4) tce	0.00	0.00	0.00	0.00	0.00	0.00	0.00	tce	0	0	29.27	1.000	0

Total emissions of China Northern Power Grid (tCO2e) 455,149,800.90

Fossil based electricity delivered to the China Northern Power Grid (TWh) 454.01

OM emissions factor of the China Northern Power Grid (tCO2e/MWh) 1.0025



2004 Fuel	Unit	Total Fuel NCPN	Beijing	Tianjing	Hebei	Shanxi	Inner			Unit	Total Fuel NCPN	Emission factor (tC/			Oxidation rate	CO2e (tonnes)
							Mongolia	Shandong	TJ			TJ	NCV (GJ/Unit)			
Coal	x10(4) tn	27228.29	823.09	1410.00	6299.80	5213.20	4932.20	8550.00	t	272,282,900	25.8	20.91	1.000	538,547,477		
Cleaned coal	x10(4) tn	40.00	0.00	0.00	0.00	0.00	0.00	40.00	t	400,000	25.8	26.34	1.000	996,706		
Other washed coal	x10(4) tn	745.91	6.48	0.00	101.04	354.17	0.00	284.22	t	7,459,100	25.8	9.41	1.000	6,639,986		
Coke	x10(4) tn	0.22	0.00	0.00	0.00	0.00	0.22	0.00	t	2,200	29.2	28.44	1.000	6,698		
Coke oven gas	x10(8) m3	15.54	0.55	0.00	0.54	5.32	0.40	8.73	m3	155,400	12.1	17.35	1.000	119,621		
Other gas	x10(8) m3	68.07	17.74	0.00	24.25	8.20	16.47	1.41	m3	680,700	12.1	16.97	1.000	512,501		
China Energy Statistical Yearbook 2005, China Statistics Press	Other coking products	x10(4) tn	15.05	15.05	0.00	0.00	0.00	0.00	t	150,500	29.2	28.44	1.000	458,269		
	Crude oil	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	t	0	20	41.82	1.000	0		
	Gasoline	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	t	0	18.9	43.07	1.000	0		
	Diesel oil	x10(4) tn	5.89	0.39	0.84	4.66	0.00	0.00	t	58,900	20.2	42.65	1.000	186,070		
	Fuel oil	x10(4) tn	14.82	14.66	0.00	0.16	0.00	0.00	t	148,200	21.1	41.82	1.000	479,451		
	LPG	x10(4) tn	0.00	0.00	0.00	0.00	0.00	0.00	t	0	17.2	50.18	1.000	0		
	Refinery gas	x10(4) tn	1.97	0.00	0.55	1.42	0.00	0.00	t	19,700	15.7	46.06	1.000	52,229		
	Natural gas	x10(8) m3	0.56	0.00	0.37	0.00	0.19	0.00	m3	5,600	15.3	38.93	1.000	12,231		
	Other energy (e.g. renewables or waste heating)	x10(4) tce	0.00	0.00	0.00	0.00	0.00	0.00	tce	0	0	29.27	1.000	0		
Total emissions of China Northern Power Grid (tCO2e)		548,011,238.56														
Fossil based electricity delivered to the China Northern Power Grid (TWh)		536.27														
OM emissions factor of the China Northern Power Grid (tCO2e/MWh)		1.0219														
Weight for 2002		0.29 0.27757278														
Weight for 2003		0.33 0.32764178														
Weight for 2004		0.39 0.39448853														
Operating Margin		0.99970308														

¹ 2006 IPCC Guidelines for National GHG Inventories: Chapter 1

² 2006 IPCC Guidelines for National GHG Inventories: Chapter 1



Table A3: Build Margin

Yearbook Data
Thermal split
Calculation cells

1999	2000	2001	2002	2003	2004
yearbook	yearbook	yearbook	yearbook	yearbook	yearbook
data	data	data	data	data	data
Year Book 2000	Year Book 2001	Year Book 2002	Year Book 2003	Year Book 2004	Year Book 2005

Baseline Data North China Power Network

Beijing

Capacity

		P572	P666	P616	P584	P709	P473
Thermal	10MW	0	339.35	341.25	340.75	334.75	345.85
Hydro	10MW	0	105.81	105.81	103.85	105.81	105.59
Nuclear	10MW	0	0	0	0	0	0
Other	10MW	0	0	0	0	0	0
Total	10MW	0	445.16	447.06	444.6	440.56	451.44

Generation

		P573	P667	P617	P585	P709	P474
Thermal	100GWh	0	179.4885	173.91	178.86	186.08	185.79
Hydro	100GWh	0	9.4734	2.75	4.66	6.79	3.47
Nuclear	100GWh	0	0	0	0	0	0
Other	100GWh	0	0	0	0	0	0
Total	100GWh	0	188.9619	176.66	183.52	192.87	189.26

Efficiency Factor

		P576	P671	P624	P592	P670	P472
Coal(power generation)	gCoal/kWh	0	329	317	319	316	317
Coal(power supply)	gCoal/kWh	0	359	352	350	340	348

**Tianjin****Capacity**

		P572	P666	P616	P584	P709	P473
Thermal	10MW	0	502.8	563.2	624.55	600.85	600.85
Hydro	10MW	0	0.5	0.5	0.5	0.5	0.5
Nuclear	10MW	0	0	0	0	0	0
Other	10MW	0	0	0	0	0	0
Total	10MW	0	503.3	563.7	625.05	601.35	601.35

Generation

		P573	P667	P617	P585	P709	P474
Thermal	100GWh	0	216.2104	221.66	272.63	321.91	339.52
Hydro	100GWh	0	0.1377	0.09	0.12	0.09	0
Nuclear	100GWh	0	0	0	0	0	0
Other	100GWh	0	0	0	0	0	0
Total	100GWh	0	216.3481	221.75	272.75	322	339.52

Efficiency Factor

		P576	P671	P624	P592	P670	P472
Coal(power generation)	gCoal/kWh	0	335	328	328	327	323
Coal(power supply)	gCoal/kWh	0	364	355	353	351	344

Hebei**Capacity**

		P572	P666	P616	P584	P709	P473
Thermal	10MW	0	1509.37	1647.49	1674.57	1769.87	1993.27
Hydro	10MW	0	72.72	74.26	77.59	76.43	78.38
Nuclear	10MW	0	0	0	0	0	0
Other	10MW	0	0	0	1.35	1.35	1.35
Total	10MW	0	1582.09	1721.75	1753.51	1847.65	2073.00

Generation

		P573	P667	P617	P585	P709	P474
Thermal	100GWh	0	839.5328	928.65	1009.7	1082.61	1249.7
Hydro	100GWh	0	4.6973	3.12	4.1	5.04	5.25
Nuclear	100GWh	0	0	0	0	0	0
Other	100GWh	0	0	0	0.36	0.37	0.4
Total	100GWh	0	844.2301	931.77	1014.16	1088.02	1255.35

Efficiency Factor

		P576	P671	P624	P592	P670	P472
Coal(power generation)	gCoal/kWh	0	361	351	348	350	350
Coal(power supply)	gCoal/kWh	0	388	377	373	375	375

**Shanxi****Capacity**

		P572	P666	P616	P584	P709	P473
Thermal	10MW	0	1177.08	1341.59	1432.78	1503.58	1769.33
Hydro	10MW	0	97.77	79.59	79.53	79.57	78.73
Nuclear	10MW	0	0	0	0	0	0
Other	10MW	0	0	0	0	0	0
Total	10MW	0	1274.85	1421.18	1512.31	1583.15	1848.06

Generation

		P573	P667	P617	P585	P709	P474
Thermal	100GWh	0	604.47466	694.19	822.56	939.62	1049.26
Hydro	100GWh	0	16.1198	16.8	18.78	18.9	20.32
Nuclear	100GWh	0	0	0	0	0	0
Other	100GWh	0	0	0	0	0	0
Total	100GWh	0	620.59446	710.99	841.34	958.52	1069.58

Efficiency Factor

		P576	P671	P624	P592	P670	P472
Coal(power generation)	gCoal/kWh	0	378	370	368	366	361
Coal(power supply)	gCoal/kWh	0	413	403	399	397	391

Inner Mongolia**Capacity**

		P572	P666	P616	P584	P709	P473
Thermal	10MW	0	850.29	889.83	977.87	1142.47	1364.15
Hydro	10MW	0	41.06	56.62	59.21	59.21	56.79
Nuclear	10MW	0	0	0	0	0	0
Other	10MW	0	0	0	7.66	7.66	11.17
Total	10MW	0	891.35	946.45	1044.74	1209.34	1432.11

Generation

		P573	P667	P617	P585	P709	P474
Thermal	100GWh	0	432.751	458.21	513.82	651.06	804.27
Hydro	100GWh	0	5.5939	6.2	6.74	6.97	8.13
Nuclear	100GWh	0	0	0	0	0	0
Other	100GWh	0	0	0	1.34	1.44	2.18
Total	100GWh	0	438.3449	464.41	521.9	659.47	814.58

Efficiency Factor

		P576	P671	P624	P592	P670	P472
Coal(power generation)	gCoal/kWh	0	363	362	360	352	336
Coal(power supply)	gCoal/kWh	0	433	395	391	381	369



Shangdong

Capacity		P572	P666	P616	P584	P709	P473
Thermal	10MW	0	1992.6	2095.77	2510.24	3049.44	3286.04
Hydro	10MW	0	8.41	5.62	5.08	5.08	5.08
Nuclear	10MW	0	0	0	0	0	0
Other	10MW	0	0	0	0	0	1.23
Total	10MW	0	2001.01	2101.39	2515.32	3054.52	3292.35

Generation		P573	P667	P617	P585	P709	P474
Thermal	100GWh	0	1000.541	1104.04	1241.62	1395.47	1639.18
Hydro	100GWh	0	0.3042	0.31	0.15	0.19	0.41
Nuclear	100GWh	0	0	0	0	0	0
Other	100GWh	0	0	0	0	0	0.16
Total	100GWh	0	1000.8452	1104.35	1241.77	1395.66	1639.75

Efficiency Factor		P576	P671	P624	P592	P670	P472
Coal(power generation)	gCoal/kWh	0	356	355	361	361	337
Coal(power supply)	gCoal/kWh	0	382	380	387	387	364

Total Thermal Capacity	MW	0.00	63714.90	68791.30	75607.60	84009.60	93594.90
Total Hydro Capacity	MW	0.00	3262.70	3224.00	3257.60	3266.00	3250.70
Total Nuclear Capacity	MW	0.00	0.00	0.00	0.00	0.00	0.00
Total Other Capacity	MW	0.00	0.00	0.00	90.10	90.10	137.50
Total Capacity	MW	0.00	66977.60	72015.30	78955.30	87365.70	96983.10

Capacity Additions (2001)	%	100.00%	7.00%	-	-	-	-
Capacity Additions (2002)	%	100.00%	15.17%	8.79%	-	-	-
Capacity Additions (2003)	%	100.00%	23.34%	17.57%	9.63%	-	-
Capacity Additions (2004)	%	100.00%	30.94%	25.74%	18.59%	9.92%	-

Total Thermal Generation	GWh	0.00	327299.84	358066.00	403919.00	457675.00	526772.00
Total Hydro Generation	GWh	0.00	3632.63	2927.00	3455.00	3798.00	3758.00
Total Nuclear Generation	GWh	0.00	0.00	0.00	0.00	0.00	0.00
Total Other Generation	GWh	0.00	0.00	0.00	170.00	181.00	274.00
	GWh	0.00	330932.47	360993.00	407544.00	461654.00	530804.00



	A	B	C	D	E	F	G	H	I	J
	Installed Capacity 2001	Installed Capacity 2004	New Capacity Additions	Split of New Capacity	Fuel Consumption	Fuel Calorific Value	CO ₂ Emission Factor	CO ₂ Emission Factor	Emissions Factor	Weighted Average Build Margin Emissions Factor
	MW	MW	MW	%	t _{SCE} */GWh	GJ/t _{SCE}	tCO ₂ /GJ	tCO ₂ /t _{SCE}	tCO ₂ /MWh	tCO ₂ /MWh
	<i>China Electric Power Yearbook 2002, page 616</i>	<i>China Electric Power Yearbook 2005, page 473</i>	= B - A		<i>BAT (http://www.cccchina.gov.cn/sourcfa/fa2002082803)</i>	<i>The General Code for Comprehensive Energy Consumption Calculation (Chinese National Standard GB2589-90)</i>	<i>Average carbon content for fuel (IPCC) * Average Oxidation Factor (IPCC)* 44/12</i>	= F * G	= E * H/1000	= D * I
Hydro	3,224.00	3,250.70	26.7	0.11%						0.000
Coal	68,791.30	93,594.90	24,803.6	99.34%	320	29.3	0.0946	2.7718	0.887	0.881
Nuclear	0.00	0.00	0.0	0.00%						0.000
Other (wind)	0.00	137.50	137.5	0.55%						0.000
Total / % Change	72,015.3	96,983.1	24,967.8	25.7%						0.881

Table A4: Combined Margin

		Units	Equation or Source	
A	Operating Margin emissions factor	tCO ₂ /MWh	Table A2	0.9997
B	Build Margin emissions factor	tCO ₂ /MWh	Table A3	0.8811
C	Combined Margin emissions factor	tCO ₂ /MWh	(=(A+B)/2)	0.9404

**Table A5: Emission factor of baseline technology**

	ID number	Value	Unit	Source
Fuel emission co-efficient		25.8	tC/ TJ	2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Fuel emission co-efficient	COEF _{BL}	0.0946	tCO ₂ /GJ	
Fuel Consumption	t _{SCE} / GWh	315	t _{SCE} /GWh	China Power Engineering Consulting Group Corporation, Thermal Power Engineering Design Reference Cost Index, 2005 edition
Fuel Calorific Value		29.3	GJ/t _{SCE}	The General Code for Comprehensive Energy Consumption Calculation (Chinese National Standard GB2589-90)
Oxidation factor		1		2006 IPCC Guidelines for National GHG Inventories (Chapter 1)
Efficiency of plant		2.7718	tCO ₂ / t _{SCE}	Calculated
Energy efficiency of plant	η _{BL}	0.3901		Calculated
Baseline scenario emission factor	EF _{BL,CO2}	0.8731	tCO ₂ / MWh	Calculated according to AM0029

Table A6: Baseline emissions

	ID number	Value	Unit	Source
Net electricity generated pa	EG _{PJ}	3,266,032	MWh	Estimated in Taiyanggong Feasibility Study Report
Baseline emissions	BE	2,851,607	tCO ₂	Calculated



Table A7: Leakage

Data type	ID number	Value	Unit	Source
Annual gas consumption	FC _{gas}	730,410,000	m ³	Taiyanggong Feasibility Study Report
Net Calorific Value	NCV _{gas}	0.03272	GJ/m ³	Taiyanggong Feasibility Study Report
Emission factor for upstream fugitive methane emissions of natural gas from production, transportation and distribution	EF _{NGupstream,CH₄}	0.000296	tCH ₄ / GJ	AM0029
Net annual electricity generation	EG _{P,J,y}	3,266,032	MWh	Taiyanggong Feasibility Study Report
Global Warming Potential of methane	GWP _{CH₄}	21	tCO ₂ e/tCH ₄	UNFCCC
Emission factor for upstream fugitive methane emissions from production of coal	EF _{k,upstream,CH₄}	0.0134	tCH ₄ /tcoal	AM0029, underground mining
Net Calorific Value of coal	NCV _{coal}	29.3	GJ/ t _{SCE}	The General Code for Comprehensive Energy Consumption Calculation (Chinese National Standard GB2589-90)
Emission factor for upstream fugitive methane emissions from production of coal	EF _{k,upstream,CH₄}	0.0005	tCH ₄ /GJ	
Emission factor for upstream fugitive methane emissions occurring in the absence of the project activity	EF _{BL,upstreamCH₄}	0.0042	tCH ₄ / MWh	
Total leakage	LE_{CH₄}	-140,948	tCO₂e	



Table A8: Emission Reductions

Data type	ID number	Value	Unit
Project emissions	PE _y	1,340,759	tCO ₂ e
Baseline emissions	BE _y	2,851,607	tCO ₂ e
Leakage	BE _y	0	tCO ₂ e
Emission Reductions	ER _y	1,510,848	tCO ₂ e

Annex 4

MONITORING INFORMATION

- - - - -

1. Introduction

This document outlines the procedures that Beijing Taiyanggong Gas-fired Thermal Power Co. Ltd. proposes to follow to ensure that the operation of the project complies with the CDM requirements.

2. Overall Project Management

Ultimate responsibility for the project rests with the General Manager of Taiyanggong Gas-Fired Combined Cycle Power Plant Company.


3. CDM Project Management and Calculations

The project sponsor will establish a CDM office which will be responsible for monitoring project emissions and other CDM related activities. An organisation chart is illustrated below. The meter reader will be responsible for compiling meter readings regularly and ensuring that the parameters identified in B7.1 are monitored. The meter reader will then send these records to the auditor who will ensure that they correspond to third party records (e.g. meter readings by the grid company or gas supply company). Any discrepancies will be reported to the office head and general manager. Following this cross-checking procedure, the readings will be stored electronically in the CDM information management system.

The calibration and maintenance of the meters will be the responsibility of the quality supervisor. The quality supervisor will supervise meter maintenance and manage the calibration process according to the company's quality control programme.

To ensure that this monitoring plan is fully implemented, a CDM manual will be prepared giving full instructions for implementation. In addition, responsibility will be assigned to an individual (the CDM project officer) in the CDM office to prepare the monitoring report for verification by the DoE and issuance of CERs.

CDM Responsibility table

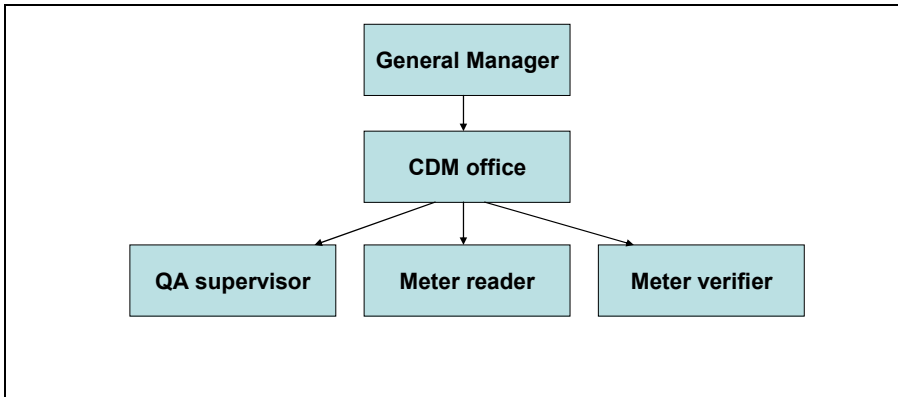


4. Procedures to be followed


A detailed monitoring plan will be developed in accordance with the company's management system.

4.1 Gas consumption monitoring

- There are three meters monitoring gas consumption: one measuring gas to each compressor and a third meter as back-up
- As a further back-up, receipts of gas supplied by the gas company will be used.

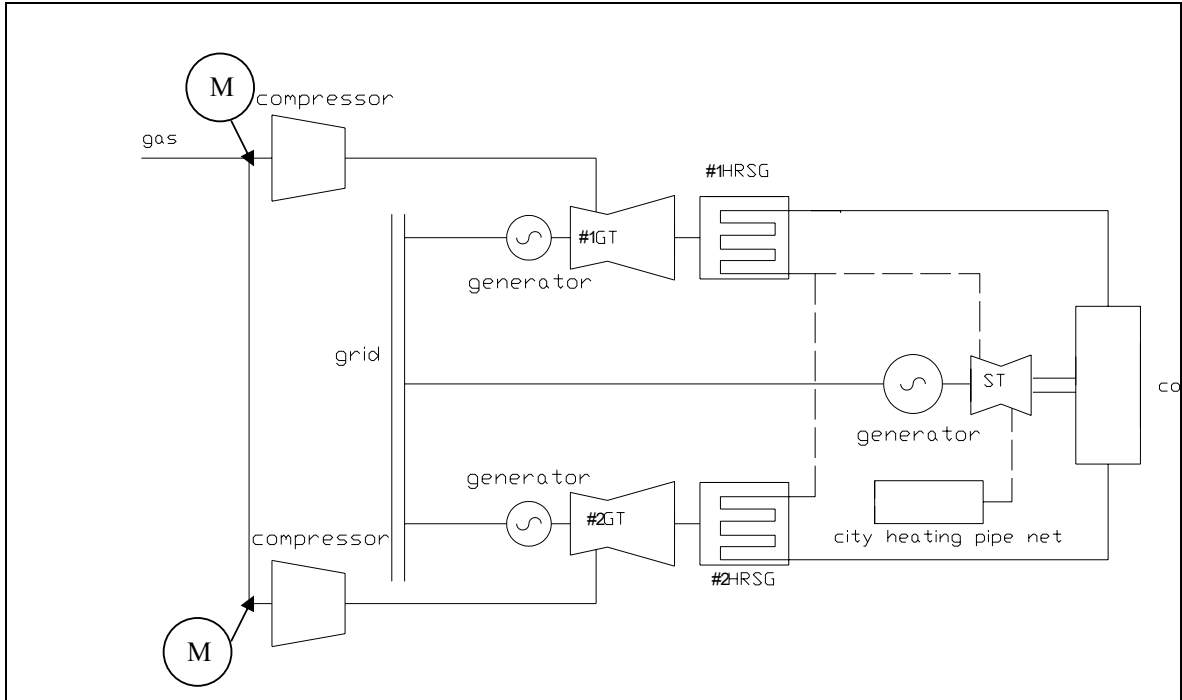

4.2 Net Electricity Generation monitoring

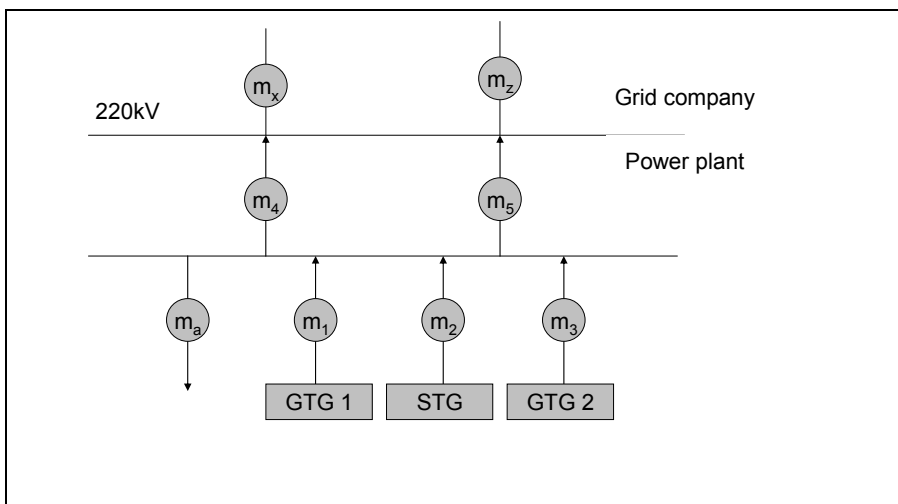

- There are 2 connections to the 220kV Beijing Power Grid, each with a meter (m_4 and m_5). These meters will measure total electricity sent to the grid.
- Each of the 3 electricity producing generators has a meter to monitor the electricity produced and sent to the main internal line (m_1 , m_2 and m_3). On-site, auxiliary use of power generated is measured by a separate meter (m_a). Back up readings will be taken from these meters
- Finally, there are two meters (m_x and m_z) owned by the Beijing Power grid company measuring the electricity supplied to the grid from the project. Readings from these will be used as a further back-up.

In summary,

$$\text{Net electricity generated} = m_4 + m_5 = (m_1 + m_2 + m_3) - m_a = m_x + m_z$$

4.3 Monitoring of diesel consumption

- The diesel generators will be used in an emergency only to supply electricity to shutdown turbines smoothly and safely. They will also be tested once a week.
- Because of this intermittent use, a flow meter is not appropriate to measure diesel consumption. Instead, diesel consumption will be calculated based on rated capacity, operating hours and generator efficiency.

5. Record Keeping, Error handling and Reporting Procedures

5.1 Record Keeping and Internal Reporting Procedure

This will be developed in accordance with the company's management procedures.

5.2 Error Handling Procedure

In the event that a meter has lost calibration over the allowable error limit then this shall be corrected at the earliest opportunity and re-calibrated and the data recorded from this meter since the last successful calibration shall be ignored.

In the event that there is uncertainty over the accuracy of the data set for net electricity generated from the main meters (e.g. the meter has lost calibration over the acceptable error limit) then the data from the back-up meters shall be used. In the event that there is uncertainty over the accuracy of the data set from the main and from the back-up meters, then power generated and delivered to the grid as evidenced by invoices and/or sales receipts shall then be used to evaluate the power generation.

Similarly for gas consumption, if there is uncertainty over the accuracy of the data set for gas consumed from the main meter, then data from the back-up meters will be used. If there is uncertainty over the accuracy of both data sets, then invoices and/ or sales receipts shall be used.

The check of the CDM Project Officer and then the third party verifier prior to issuance of the CERs is considered adequate for errors in the calculations. Where errors in the calculations are discovered by either of these Parties, the monitoring report shall be modified and the corrected version shall be resubmitted to the verifier.

5.3 External Reporting Procedure

After signing by the CDM Project Officer, the report is sent to the 3rd party verifier who is contracted to verify the emissions reductions during the crediting period of the project.

5.4 Procedure for corrective actions arising

The CDM Project Officer is responsible for identifying corrective actions arising from the above procedures and for liaising with the purchaser, the 3rd party verifiers and other stakeholders to take necessary steps to implement the corrective actions.

6. Standard Template for Reporting of Data for Verification of CERs

Name of Project: Taiyanggong Natural Gas-Fired Combined Cycle Power Plant Project

Crediting Period for which CERs are claimed:

From [---Insert Date---] **to** [---Insert Date---]

Author of this Report: [Insert Name]

Date of Issuance of this Report to Verifier: [---Insert Date---]

Name and contact details of Verifier: [Insert]

Number of ER's claimed during period: [Insert Number] t CO₂e

Baseline emissions Factor: 0.8731 tCO₂e per MWh

Generated Electricity (net of auxiliary power): [insert number] MWh

Gas consumed: [insert number] m³

Diesel consumed: [insert number] tonnes

Calculation and Data:

Month	Generation Period (Start Date/End Date)	Estimation of project activity emissions (tonnes of CO ₂ e)	Estimation of baseline emissions (tonnes of CO ₂ e)	Estimation of leakage (tonnes of CO ₂ e)	Estimation of overall emissions reductions (tonnes of CO ₂ e)
Total					

Comments:

Signed: _____ (CDM Officer) Date: _____